

**GOWANUS CANAL SUPERFUND SITE
RTA1 REMEDIAL CONSTRUCTION
Water Quality Monitoring Weekly Data Summary**

PERIOD: July 24 – July 28, 2023

Date of Report: August 1, 2023

Report Contents

- Scope of Monitoring
- Report of Exceedances
- Turbidity Buoy Data
- Summary of Visual Observations

Prepared by

B&B Engineers & Geologists 
of new york, p.c.

an affiliate of Geosyntec Consultants

1255 Roberts Blvd, Suite 200
Kennesaw, GA 30144
Project Number JR0289A

1. SCOPE OF MONITORING

1.1 Current Buoy Locations


The following report summarizes water quality monitoring data collected during the week of July 24, 2023. In accordance with the Water Quality Monitoring Plan for In-waterway Construction Activities (WQMP) three turbidity buoys were deployed to monitor turbidity related to dredging activities. One turbidity buoy was deployed just south of the 3rd Street Bridge outside of the air curtain and traditional turbidity curtain and is referred to as the 3rd Street Sentinel Buoy. A second turbidity buoy was deployed just south of Carroll St Bridge to monitor dredging activities north of Carroll Street Bridge and is referred to as the Carroll Street Sentinel Buoy. The third turbidity buoy was deployed in the Fourth Street Turning Basin in order to monitor background turbidity unaffected by in-water construction activities and is referred to as the Ambient Buoy.

Each turbidity buoy was equipped with a YSI EXO3 water quality meter with optical turbidity sensor. The buoys were field calibrated and programmed such that readings were collected every 15 minutes. After each measurement, the turbidity data were transmitted to a File Transfer Portal (FTP) site via telemetry. No handheld measurements were collected during this reporting period. Visual observations of turbidity and sheen are summarized in Section 4.

1.2 Previous Buoy Locations

- On January 22, 2021, prior to dredging north of the Union Street Bridge, a fourth turbidity buoy was deployed just south of the Union Street Bridge and was referred to as the Union Street Sentinel Buoy. This fourth turbidity buoy was removed prior to the start of pipe pile installation.
- On Wednesday, September 22, 2021, the Carroll Street Sentinel Buoy was relocated to the west side of the canal where Degraw Street intersects the canal to monitor cofferdam removal activities conducted in the vicinity of the Flushing Tunnel. This buoy was renamed the Degraw Street Sentinel Buoy during cofferdam removal activities.
- On October 14, 2021, the Degraw Street Sentinel Buoy was removed from the canal for servicing. On October 20, 2021, the Degraw Street Sentinel Buoy was redeployed to its position south of the Carroll Street Bridge and was renamed to the Carroll Street Sentinel Buoy.
- On November 15, 2021, the Carroll Street Sentinel Buoy was moved to the Union Street Bridge and renamed the Union Street Sentinel Buoy. On December 3, 2021, the Union Street Buoy was removed from the canal for servicing and re-deployed at 3rd Street Bridge in preparation for the resumption of ISS operations. On December 8, 2021, a sentinel buoy was re-deployed just south of the Carroll Street Bridge.
- Since December 8, 2021, the sentinel buoy deployed at the northern-most portion of the canal has alternated positioning between the Union Street Bridge and Carroll Street Bridge locations based on the in-canal construction activities being conducted at any given time.


- On January 9, 2023, the Carroll Street Sentinel Buoy was moved to the Third Street Bridge location and renamed the Third Street Sentinel Buoy. Additionally, the former Third Street Sentinel Buoy was removed from the canal for servicing.
- On February 6, 2023, the newly serviced Third Street Sentinel Buoy was reinstalled at Third Street Bridge, and the former Carroll Street Sentinel Buoy was reinstalled at Carroll Street Bridge.
- The Ambient Buoy was removed from service on Friday, February 17, 2023, due to a faulty communications system. Following investigation into the cause of the fault and the appropriate repairs made, the Ambient Buoy was returned to service on Thursday, April 13, 2023. Due to similar issues, the Ambient Buoy was removed from service again on Monday, April 24, 2023, before being redeployed on Friday, May 12, 2023, and again removed from service on Monday, May 15, 2023, before being redeployed on Monday, June 12, 2023.
- On Thursday April 13, 2023, the Carroll Street Sentinel Buoy was assessed to be within 100ft of in-canal construction activities being conducted at Carroll Street Bridge, and consequently was repositioned to the North Third Street Sentinel Buoy location.
- Data from the Third Street Sentinel Buoy was not reported from Thursday June 1, 2023 to June 2, 2023 due to a power failure and/or faulty communications system preventing transmission of readings. The Third Street Sentinel Buoy was returned to service with data collection resuming on June 5, 2023.

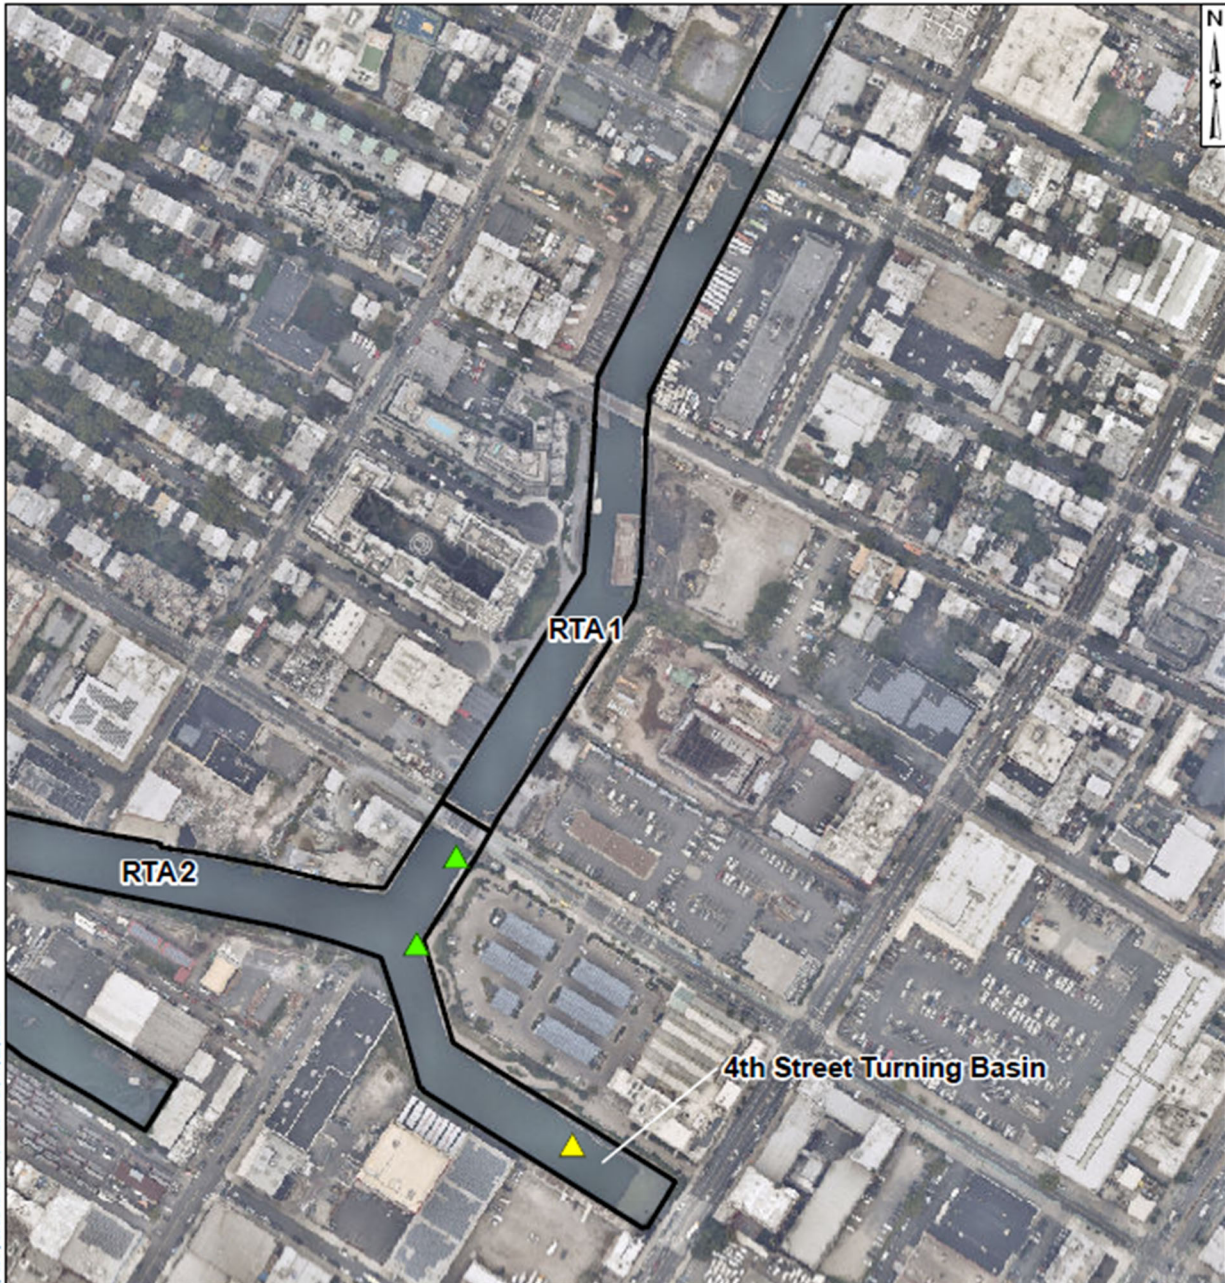

\\fileserver\Gowanus\PR_7\03_GIS\mxd\Canal\Wide\Turbidity_Buoy_Locations.mxd; otaufman; 11/25/2020

Legend

- ▲ Ambient Buoy
- ▲ Sentinel Buoy
- RTA Boundary



Turbidity Buoy Locations

Gowanus Canal, Brooklyn, NY

B&B Engineers & Geologists
of new york, p.c.

an affiliate of Geosyntec Consultants

Brooklyn, NY

May 2023

Figure

1

2. REPORT OF EXCEEDANCES

No exceedances due to remedial construction-related activities to the quantitative trigger or action criteria were observed during the reporting period.

- **Trigger criterion** – Any of the following:
 - The rolling average of the relevant sentinel buoy turbidity measurements over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 20 NTU excluding any eliminated outlier measurements and in-waterway construction activities cannot be immediately excluded as the source following consultation with EPA; or
 - Either an oil sheen or a turbidity plume is visually observed at the relevant sentinel buoy and in-waterway construction activities are readily identified as the source.
- **Action criterion** – Any of the following:
 - The rolling average of the turbidity measurements of the sentinel buoy outside of RTA1 over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 40 NTU excluding any eliminated outlier measurements and in-waterway construction activities cannot be immediately excluded as the source following consultation with EPA; or
 - Either an oil sheen or a turbidity plume is visually observed outside of RTA1 and any deployed engineering controls and in-waterway construction activities are readily identified as the source.

An outlier is defined as a reading that is outside the range of 50 to 200 percent of the average of the three previous readings. In addition, to be considered an outlier, the subsequent reading must return to a range of 75 to 133 percent of the average of the three readings preceding the outlier.

2.1 Response to Criteria Exceedances

The trigger level criterion serves to provide early notification to the contractor of construction activities that may lead to an exceedance of the action level criterion. In the event of an exceedance to the trigger criterion, the contractor will not be stopped, and the contractor will be directed to investigate the source of the exceedance and evaluate Best Management Practices (BMPs). In the event of an exceedance to the action level criterion, in-waterway construction activities may be slowed or temporarily suspended as necessary while the contractor investigates the source of the exceedance and appropriate mitigation and corrective measures are determined. A more detailed description of responses to exceedances of the trigger and action level criteria is provided in Section 4.2 of the WQMP.

No exceedances due to remedial construction-related activities to the quantitative trigger or action criteria were observed during the reporting period.

3. TURBIDITY BUOY DATA

The following section provides turbidity data for the sentinel and ambient turbidity buoys from 7 AM to 6 PM from July 24 – July 28, 2023.

No exceedances due to remedial construction-related activities to the quantitative trigger or action criteria were observed during the reporting period. Elevated turbidity readings occurred on Tuesday, July 25 due to CSO discharges during an intense and sustained heavy rain event.


Table 1 below provides a summary of the turbidity data for the reporting period.

Date	Average Rolling Average Difference (NTU)		Maximum Rolling Average Difference (NTU)	
	W TB4 - Ambient	S 3rd St - Ambient	W TB4 - Ambient	S 3rd St - Ambient
Monday, July 24, 2023	4.82	0.29	7.46	2.96
Tuesday, July 25, 2023	7.56	3.48	25.71	20.44
Wednesday, July 26, 2023	6.78	3.95	10.00	7.57
Thursday, July 27, 2023	5.56	0.98	9.73	3.54
Friday, July 28, 2023	6.73	3.91	9.94	8.86

Table 1. Daily average and maximum differences between the rolling average turbidity readings from RTA1 sentinel buoys and the ambient buoy between 7 AM and 6 PM.

3.1 Monday, July 24, 2023


Figure 3. Hourly rolling average turbidity readings on Monday, July 24, 2023, from 7 AM to 6 PM.

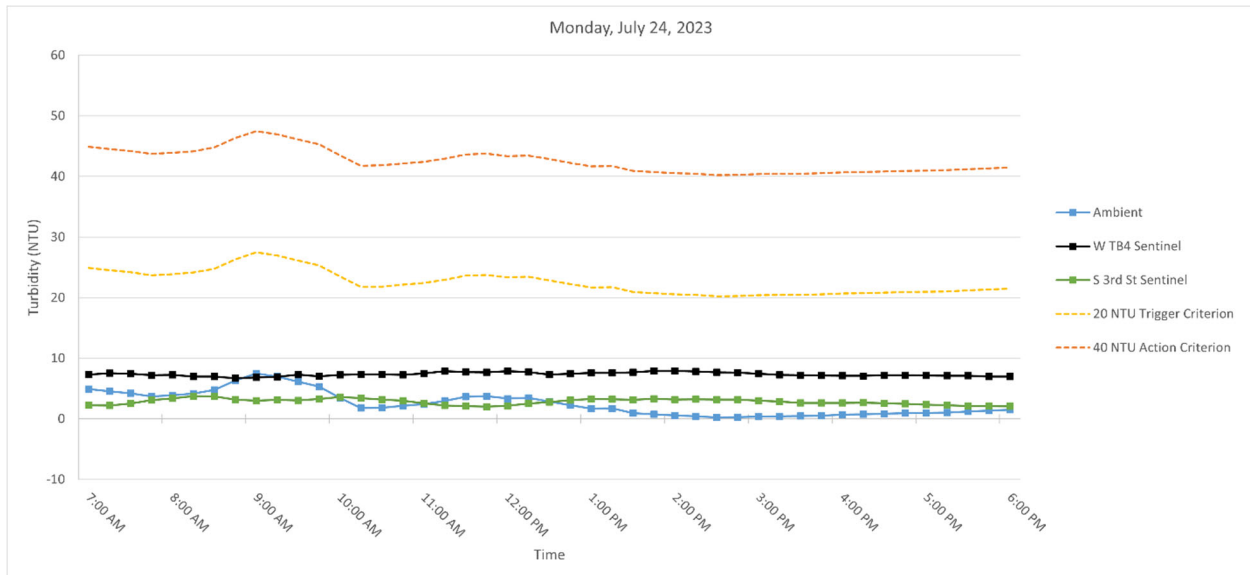

Note: No outlier turbidity readings above 20 NTU were detected.

3.2 Tuesday, July 25, 2023


Figure 3. Hourly rolling average turbidity readings on Tuesday, July 25, 2023, from 7 AM to 6 PM.

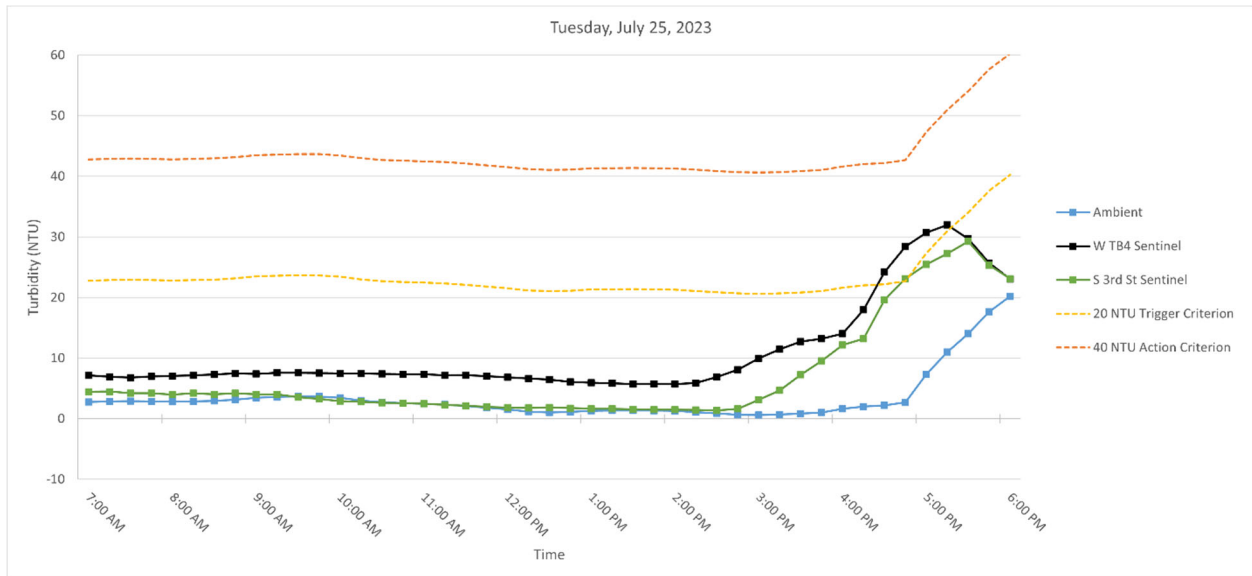

Note: Elevated turbidity readings occurred due to CSO discharges during an intense and sustained heavy rain event.

3.3 Wednesday, July 26, 2023


Figure 4. Hourly rolling average turbidity readings on Wednesday, July 26, 2023, from 7 AM to 6 PM.

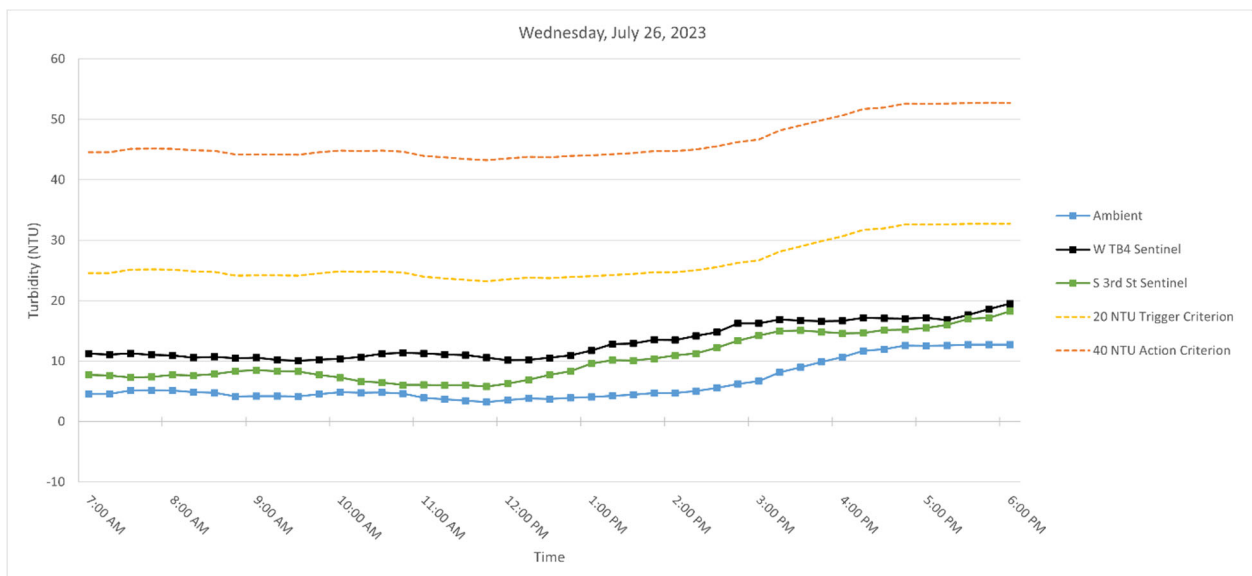

Note: No outlier turbidity readings above 20 NTU were detected.

3.4 Thursday, July 27, 2023


Figure 5. Hourly rolling average turbidity readings on Thursday, July 27, 2023, from 7 AM to 6 PM.

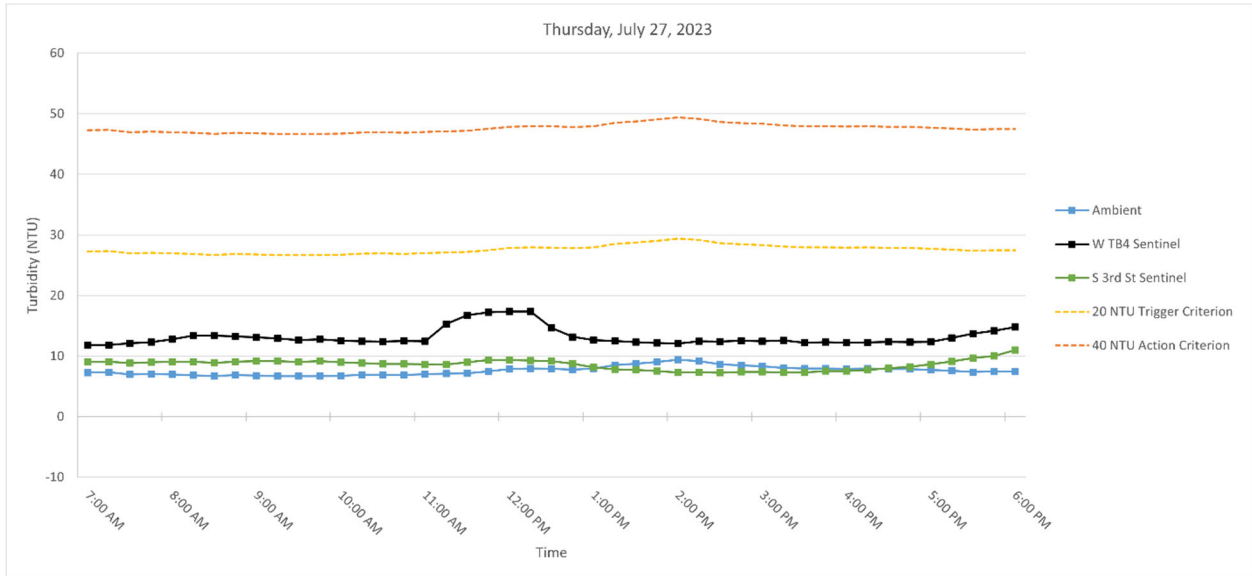

Note: No outlier turbidity readings above 20 NTU were detected.

3.5 Friday, July 28, 2023

Figure 6. Hourly rolling average turbidity readings on Friday, July 28, 2023, from 7 AM to 6 PM.

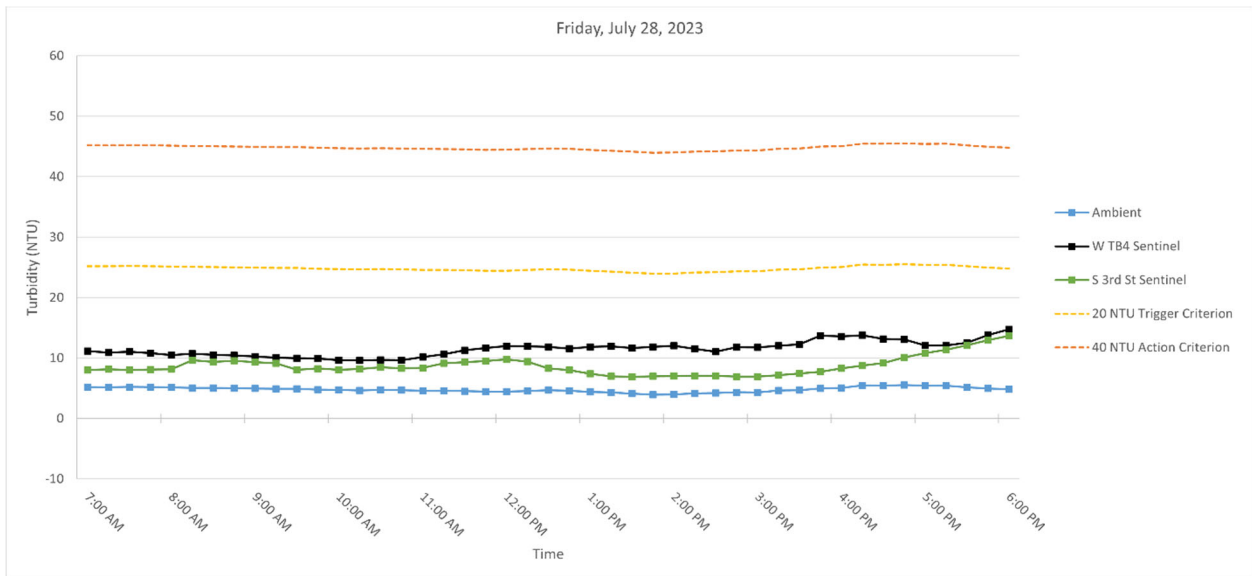

Note: No outlier turbidity readings above 20 NTU were detected.

SUMMARY OF VISUAL OBSERVATIONS

Visual indications of elevated turbidity were periodically observed during the reporting period attributable to capping activities. No sheens attributable to in-canal work operations were observed above background conditions.

Elevated turbidity and occasional sheens were observed throughout the reporting period, being attributed to CSOs contributing high volumes of excess outflow into the canal during intense and sustained heavy rain events (as opposed to any work-related activities). Turbid and sheen discharges were observed during the reporting period from storm water outfalls, including from the high-level storm sewer pipe adjacent to OH-005.

Throughout the reporting period, a dark coloration of the water was observed in RTA1 and RTA2 suggesting a decrease in dissolved oxygen levels in the canal attributable to the loading of organic materials during CSO discharge events and urban runoff. EPA has been notified of the observation.

Photographs depicting conditions relevant to these events are shown below.

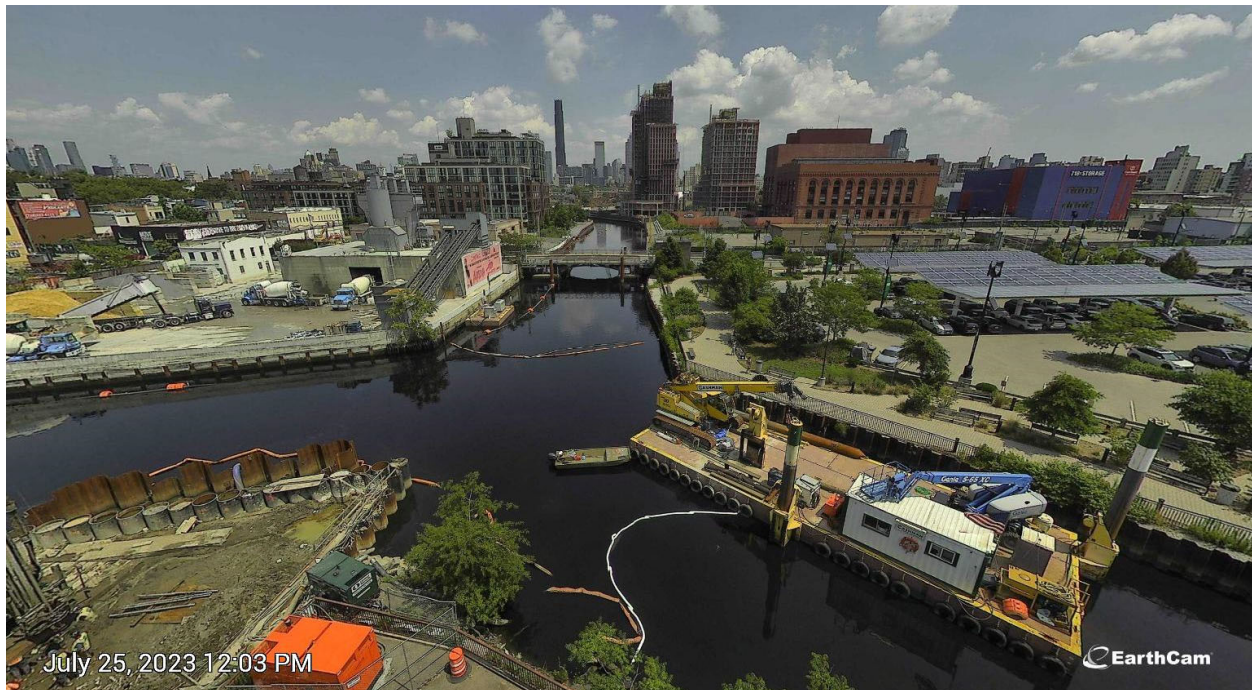


Figure 7. Deployment of turbidity curtain and absorbent boom on July 25, 2023 at 12:00 PM.

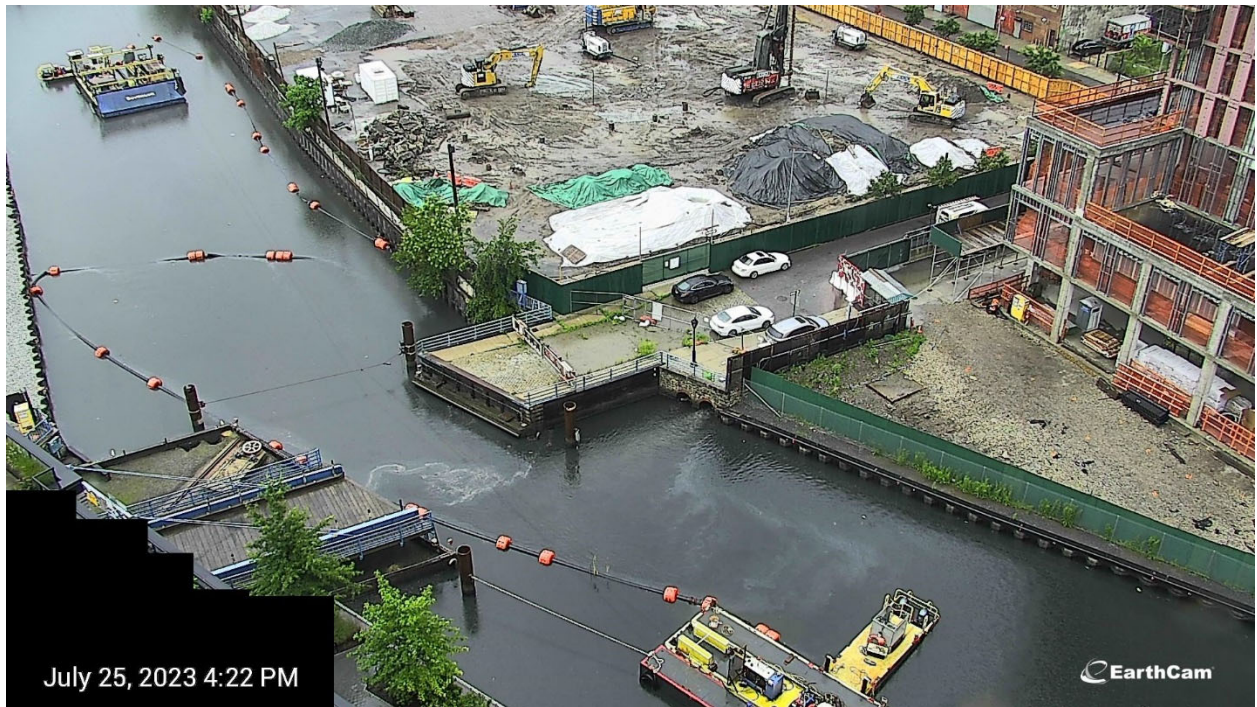


Figure 8. CSO discharge during heavy rain event on July 25, 2023 at 4:15 PM.

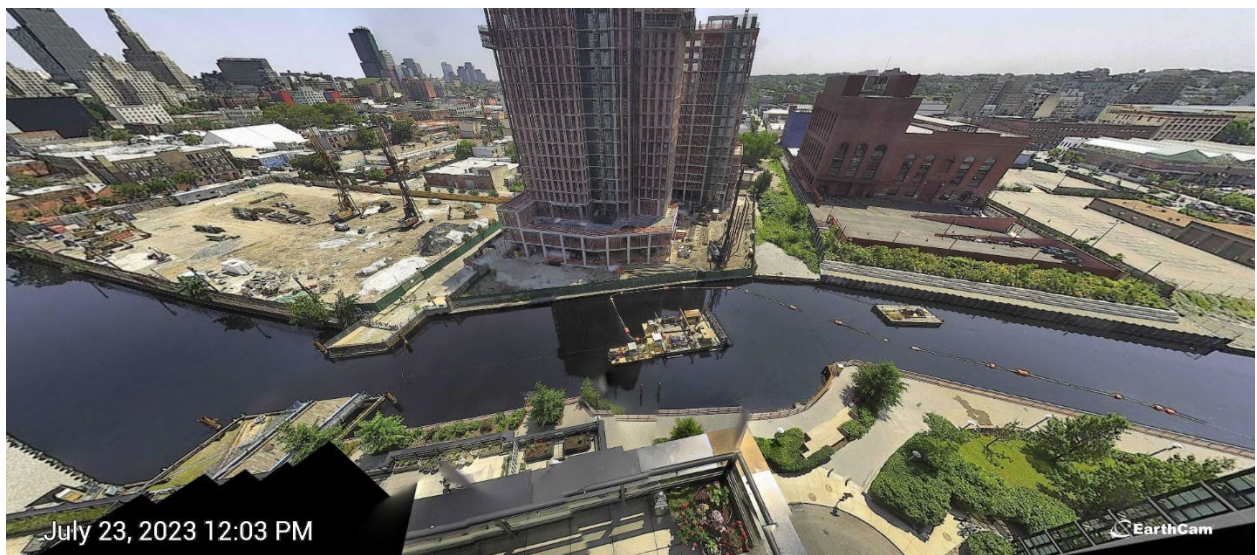


Figure 9. Dark coloration of the water noted in the canal on July 23, 2023 at 12:00PM.

APPENDIX A
Turbidity Data Tables

Monday, July 24, 2023

Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
	Ambient	W TB4	S 3rd Street	Ambient	W TB4	S 3rd Street	W TB4 - Ambient	S 3rd St - Ambient
7:00:00	4.65	7.39	2.82	4.90	7.30	2.26	2.41	-2.63
7:15:00	2.83	8.06	2.49	4.53	7.53	2.18	2.99	-2.35
7:30:00	2.87	7.18	3.73	4.19	7.45	2.51	3.26	-1.68
7:45:00	3.61	6.69	4.43	3.70	7.20	3.09	3.50	-0.61
8:00:00	5.49	6.98	--	3.89	7.26	3.37	3.37	-0.52
8:15:00	5.99	5.85	4.27	4.16	6.95	3.73	2.79	-0.43
8:30:00	5.94	8.23	2.41	4.78	6.99	3.71	2.21	-1.07
8:45:00	10.61	5.7	1.55	6.33	6.69	3.17	0.36	-3.16
9:00:00	9.36	7.36	3.79	7.48	6.82	3.01	-0.65	-4.47
9:15:00	2.94	7.5	3.65	6.97	6.93	3.13	-0.04	-3.83
9:30:00	1.74	7.65	3.86	6.12	7.29	3.05	1.17	-3.07
9:45:00	1.98	6.78	3.57	5.33	7.00	3.28	1.67	-2.04
10:00:00	1.37	6.94	3.19	3.48	7.25	3.61	3.77	0.13
10:15:00	0.74	7.86	2.73	1.75	7.35	3.40	5.59	1.65
10:30:00	3.33	7.48	2.58	1.83	7.34	3.19	5.51	1.35
10:45:00	3.23	7.09	2.78	2.13	7.23	2.97	5.10	0.84
11:00:00	3.4	7.95	1.56	2.41	7.46	2.57	5.05	0.15
11:15:00	4.04	8.92	1.24	2.95	7.86	2.18	4.91	-0.77
11:30:00	4.24	7.15	2.37	3.65	7.72	2.11	4.07	-1.54
11:45:00	3.83	7.21	2.18	3.75	7.66	2.03	3.92	-1.72
12:00:00	1.2	7.98	3.39	3.34	7.84	2.15	4.50	-1.19
12:15:00	3.92	7.32	3.43	3.45	7.72	2.52	4.27	-0.92
12:30:00	1.12	6.94	2.43	2.86	7.32	2.76	4.46	-0.10
12:45:00	1.09	7.81	3.89	2.23	7.45	3.06	5.22	0.83
13:00:00	1.01	7.93	3.32	1.67	7.60	3.29	5.93	1.62
13:15:00	1.38	7.97	3.07	1.70	7.59	3.23	5.89	1.52
13:30:00	0.06	7.66	2.84	0.93	7.66	3.11	6.73	2.18
13:45:00	0.09	8.13	3.38	0.73	7.90	3.30	7.17	2.57
14:00:00	0.17	7.9	3.31	0.54	7.92	3.18	7.38	2.64
14:15:00	0.45	7.34	3.62	0.43	7.80	3.24	7.37	2.81
14:30:00	0.38	7.42	2.78	0.23	7.69	3.19	7.46	2.96
14:45:00	0.29	7.31	2.74	0.28	7.62	3.17	7.34	2.89
15:00:00	0.64	7.29	2.49	0.39	7.45	2.99	7.07	2.60
15:15:00	0.41	6.89	2.53	0.43	7.25	2.83	6.82	2.40
15:30:00	0.57	7.13	2.52	0.46	7.21	2.61	6.75	2.15
15:45:00	0.74	7.18	2.75	0.53	7.16	2.61	6.63	2.08
16:00:00	1.02	7.03	2.8	0.68	7.10	2.62	6.43	1.94
16:15:00	0.95	7.21	2.75	0.74	7.09	2.67	6.35	1.93
16:30:00	0.8	7.45	1.92	0.82	7.20	2.55	6.38	1.73
16:45:00	1.11	7.11	2.14	0.92	7.20	2.47	6.27	1.55
17:00:00	1	7.08	2.15	0.98	7.18	2.35	6.20	1.38
17:15:00	1.29	6.74	2.17	1.03	7.12	2.23	6.09	1.20
17:30:00	1.76	7.15	2.1	1.19	7.11	2.10	5.91	0.90
17:45:00	1.52	6.79	1.97	1.34	6.97	2.11	5.64	0.77
18:00:00	1.82	7.02	1.97	1.48	6.96	2.07	5.48	0.59

Tuesday, July 25, 2023

Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
	Ambient	W TB4	S 3rd Street	Ambient	W TB4	S 3rd Street	W TB4 - Ambient	S 3rd St - Ambient
7:00:00	2.74	6.76	3.97	2.77	7.17	4.46	4.41	1.69
7:15:00	2.81	6.76	4.67	2.86	6.92	4.46	4.06	1.60
7:30:00	2.89	6.82	3.18	2.91	6.76	4.23	3.85	1.31
7:45:00	2.62	7.86	4.37	2.87	6.95	4.20	4.08	1.33
8:00:00	2.92	6.99	3.6	2.80	7.04	3.96	4.24	1.16
8:15:00	3.06	7.26	5.22	2.86	7.14	4.21	4.28	1.35
8:30:00	3.26	7.46	3.76	2.95	7.28	4.03	4.33	1.08
8:45:00	3.87	7.88	4.17	3.15	7.49	4.22	4.34	1.08
9:00:00	4.24	7.45	3.23	3.47	7.41	4.00	3.94	0.53
9:15:00	3.56	7.8	3.64	3.60	7.57	4.00	3.97	0.41
9:30:00	3.44	7.34	3	3.67	7.59	3.56	3.91	-0.11
9:45:00	3.16	7.2	2.29	3.65	7.53	3.27	3.88	-0.39
10:00:00	2.78	7.68	2.23	3.44	7.49	2.88	4.06	-0.56
10:15:00	2.02	7.31	2.78	2.99	7.47	2.79	4.47	-0.20
10:30:00	2.04	7.37	2.86	2.69	7.38	2.63	4.69	-0.06
10:45:00	2.85	7.18	2.66	2.57	7.35	2.56	4.78	-0.01
11:00:00	2.68	7.13	1.75	2.47	7.33	2.46	4.86	-0.02
11:15:00	2.11	6.8	1.42	2.34	7.16	2.29	4.82	-0.05
11:30:00	0.85	7.48	2.01	2.11	7.19	2.14	5.09	0.03
11:45:00	0.5	6.49	2.01	1.80	7.02	1.97	5.22	0.17
12:00:00	--	6.16	1.83	1.54	6.81	1.80	5.28	0.27
12:15:00	1.21	6.35	1.68	1.17	6.66	1.79	5.49	0.62
12:30:00	1.6	5.67	1.84	1.04	6.43	1.87	5.39	0.83
12:45:00	1.12	5.8	1.37	1.11	6.09	1.75	4.99	0.64
13:00:00	1.35	5.65	1.52	1.32	5.93	1.65	4.61	0.33
13:15:00	1.41	5.72	1.67	1.34	5.84	1.62	4.50	0.28
13:30:00	1.37	5.77	1.2	1.37	5.72	1.52	4.35	0.15
13:45:00	1.38	5.8	1.75	1.33	5.75	1.50	4.42	0.18
14:00:00	0.88	5.67	1.28	1.28	5.72	1.48	4.44	0.21
14:15:00	0.33	6.42	1.22	1.07	5.88	1.42	4.80	0.35
14:30:00	0.38	10.75	1.37	0.87	6.88	1.36	6.01	0.50
14:45:00	0.36	11.74	2.58	0.67	8.08	1.64	7.41	0.97
15:00:00	1.08	15.13	9.28	0.61	9.94	3.15	9.34	2.54
15:15:00	1.22	13.36	8.91	0.67	11.48	4.67	10.81	4.00
15:30:00	1.18	12.55	14.17	0.84	12.71	7.26	11.86	6.42
15:45:00	1.35	13.11	12.68	1.04	13.18	9.52	12.14	8.49
16:00:00	3.27	16.02	15.75	1.62	14.03	12.16	12.41	10.54
16:15:00	3.03	34.75	14.5	2.01	17.96	13.20	15.95	11.19
16:30:00	2.1	44.65	40.91	2.19	24.22	19.60	22.03	17.42
16:45:00	3.75	33.5	31.86	2.70	28.41	23.14	25.71	20.44
17:00:00	24.56	24.55	24.24	7.34	30.69	25.45	23.35	18.11
17:15:00	21.44	22.36	24.75	10.98	31.96	27.25	20.99	16.28
17:30:00	18.38	23.23	24.48	14.05	29.66	29.25	15.61	15.20
17:45:00	20.13	24.77	21.23	17.65	25.68	25.31	8.03	7.66
18:00:00	16.66	20.31	20.79	20.23	23.04	23.10	2.81	2.86

Wednesday, July 26, 2023

Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
	Ambient	W TB4	S 3rd Street	Ambient	W TB4	S 3rd Street	W TB4 - Ambient	S 3rd St - Ambient
7:00:00	5.57	12.58	7.82	4.55	11.23	7.71	6.68	3.17
7:15:00	4.7	9.1	7.73	4.56	11.06	7.64	6.50	3.07
7:30:00	6.62	12.03	5.74	5.12	11.27	7.30	6.14	2.18
7:45:00	4.68	9.77	8.14	5.17	11.04	7.40	5.87	2.23
8:00:00	4.04	11.16	9.05	5.12	10.93	7.70	5.81	2.57
8:15:00	4.28	10.9	7.35	4.86	10.59	7.60	5.73	2.74
8:30:00	4.25	9.6	8.99	4.77	10.69	7.85	5.92	3.08
8:45:00	3.56	10.86	8.19	4.16	10.46	8.34	6.30	4.18
9:00:00	4.84	10.29	8.9	4.19	10.56	8.50	6.37	4.30
9:15:00	4.05	9.36	8.23	4.20	10.20	8.33	6.01	4.14
9:30:00	4.01	10.22	6.99	4.14	10.07	8.26	5.92	4.12
9:45:00	6.26	10.6	6.35	4.54	10.27	7.73	5.72	3.19
10:00:00	5.12	11.45	5.89	4.86	10.38	7.27	5.53	2.42
10:15:00	4.35	11.81	5.83	4.76	10.69	6.66	5.93	1.90
10:30:00	4.37	12.07	7.19	4.82	11.23	6.45	6.41	1.63
10:45:00	3.1	10.98	5.01	4.64	11.38	6.05	6.74	1.41
11:00:00	2.78	10.01	6.54	3.94	11.26	6.09	7.32	2.15
11:15:00	3.88	10.6	5.44	3.70	11.09	6.00	7.40	2.31
11:30:00	3.09	11.31	6.05	3.44	10.99	6.05	7.55	2.60
11:45:00	3.32	9.97	5.89	3.23	10.57	5.79	7.34	2.55
12:00:00	4.65	8.9	7.36	3.54	10.16	6.26	6.61	2.71
12:15:00	4.18	10.14	9.91	3.82	10.18	6.93	6.36	3.11
12:30:00	3.33	12.42	9.28	3.71	10.55	7.70	6.83	3.98
12:45:00	4.17	13.32	9.11	3.93	10.95	8.31	7.02	4.38
13:00:00	3.88	13.97	12.21	4.04	11.75	9.57	7.71	5.53
13:15:00	5.67	14.34	10.3	4.25	12.84	10.16	8.59	5.92
13:30:00	5.12	10.6	9.69	4.43	12.93	10.12	8.50	5.68
13:45:00	4.82	15.31	10.73	4.73	13.51	10.41	8.78	5.68
14:00:00	4.17	13.11	11.68	4.73	13.47	10.92	8.73	6.19
14:15:00	5.45	17.44	13.85	5.05	14.16	11.25	9.11	6.20
14:30:00	8.17	17.53	15.03	5.55	14.80	12.20	9.25	6.65
14:45:00	8.57	17.79	15.55	6.24	16.24	13.37	10.00	7.13
15:00:00	6.96	15.2	15.06	6.66	16.21	14.23	9.55	7.57
15:15:00	11.58	16.5	15.3	8.15	16.89	14.96	8.75	6.81
15:30:00	9.68	16.59	14.39	8.99	16.72	15.07	7.73	6.07
15:45:00	12.5	16.93	13.74	9.86	16.60	14.81	6.74	4.95
16:00:00	12.54	18.12	14.42	10.65	16.67	14.58	6.02	3.93
16:15:00	12.28	17.67	15.44	11.72	17.16	14.66	5.45	2.94
16:30:00	12.81	16.14	17.85	11.96	17.09	15.17	5.13	3.21
16:45:00	12.9	16.21	14.49	12.61	17.01	15.19	4.41	2.58
17:00:00	12.27	17.79	15.3	12.56	17.19	15.50	4.63	2.94
17:15:00	12.73	16.24	17	12.60	16.81	16.02	4.21	3.42
17:30:00	12.84	21.81	20.22	12.71	17.64	16.97	4.93	4.26
17:45:00	12.94	21.03	18.79	12.74	18.62	17.16	5.88	4.42
18:00:00	12.83	20.69	19.98	12.72	19.51	18.26	6.79	5.54

Thursday, July 27, 2023

Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
	Ambient	W TB4	S 3rd Street	Ambient	W TB4	S 3rd Street	W TB4 - Ambient	S 3rd St - Ambient
7:00:00	7.24	10.41	9.18	7.26	11.85	9.04	4.59	1.78
7:15:00	7.5	12.35	9.07	7.35	11.83	9.06	4.48	1.71
7:30:00	5.89	13.77	8.66	6.96	12.10	8.85	5.14	1.90
7:45:00	7.11	13.38	9.02	7.05	12.31	8.99	5.26	1.94
8:00:00	7.08	13.85	9.29	6.96	12.75	9.04	5.79	2.08
8:15:00	6.63	13.56	9.23	6.84	13.38	9.05	6.54	2.21
8:30:00	6.61	12.41	8.22	6.66	13.39	8.88	6.73	2.22
8:45:00	6.88	13.01	9.53	6.86	13.24	9.06	6.38	2.20
9:00:00	6.61	12.66	9.43	6.76	13.10	9.14	6.34	2.38
9:15:00	6.72	12.88	9.32	6.69	12.90	9.15	6.21	2.46
9:30:00	6.63	12.21	8.65	6.69	12.63	9.03	5.94	2.34
9:45:00	6.59	13.02	8.86	6.69	12.76	9.16	6.07	2.47
10:00:00	7.03	11.98	8.6	6.72	12.55	8.97	5.83	2.26
10:15:00	7.5	12.06	8.8	6.89	12.43	8.85	5.54	1.95
10:30:00	6.93	12.77	8.52	6.94	12.41	8.69	5.47	1.75
10:45:00	6.29	12.51	8.72	6.87	12.47	8.70	5.60	1.83
11:00:00	7.33	12.86	8.47	7.02	12.44	8.62	5.42	1.61
11:15:00	7.4	26.29	8.52	7.09	15.30	8.61	8.21	1.52
11:30:00	7.9	19.28	10.6	7.17	16.74	8.97	9.57	1.80
11:45:00	8.53	15.17	10.33	7.49	17.22	9.33	9.73	1.84
12:00:00	8.04	13.07	8.88	7.84	17.33	9.36	9.49	1.52
12:15:00	7.89	12.91	7.84	7.95	17.34	9.23	9.39	1.28
12:30:00	7.21	12.85	8.25	7.91	14.66	9.18	6.74	1.27
12:45:00	7.2	11.82	8.44	7.77	13.16	8.75	5.39	0.97
13:00:00	9.42	12.58	7.19	7.95	12.65	8.12	4.69	0.17
13:15:00	10.79	12.25	7.33	8.50	12.48	7.81	3.98	-0.69
13:30:00	9.07	11.97	7.33	8.74	12.29	7.71	3.56	-1.03
13:45:00	8.71	12.25	7.37	9.04	12.17	7.53	3.14	-1.51
14:00:00	8.89	11.36	7.24	9.38	12.08	7.29	2.71	-2.08
14:15:00	8.31	14.4	7.34	9.15	12.45	7.32	3.29	-1.83
14:30:00	8.19	12.09	7.01	8.63	12.41	7.26	3.78	-1.38
14:45:00	8.21	12.46	7.85	8.46	12.51	7.36	4.05	-1.10
15:00:00	8.07	11.97	7.46	8.33	12.46	7.38	4.12	-0.95
15:15:00	7.51	11.92	6.83	8.06	12.57	7.30	4.51	-0.76
15:30:00	7.72	12.62	7.3	7.94	12.21	7.29	4.27	-0.65
15:45:00	8.18	12.63	8.19	7.94	12.32	7.53	4.38	-0.41
16:00:00	7.98	11.92	7.92	7.89	12.21	7.54	4.32	-0.35
16:15:00	8.28	12.2	8.28	7.93	12.26	7.70	4.32	-0.23
16:30:00	7.15	12.32	8.33	7.86	12.34	8.00	4.48	0.14
16:45:00	7.56	12.49	8.33	7.83	12.31	8.21	4.48	0.38
17:00:00	7.58	12.69	10.35	7.71	12.32	8.64	4.61	0.93
17:15:00	7.2	15.21	10.35	7.55	12.98	9.13	5.43	1.57
17:30:00	7.3	15.74	11.1	7.36	13.69	9.69	6.33	2.33
17:45:00	7.78	14.73	9.94	7.48	14.17	10.01	6.69	2.53
18:00:00	7.43	15.5	13.26	7.46	14.77	11.00	7.32	3.54

Friday, July 28, 2023

Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
	Ambient	W TB4	S 3rd Street	Ambient	W TB4	S 3rd Street	W TB4 - Ambient	S 3rd St - Ambient
7:00:00	5.06	10.41	6.95	5.20	11.15	7.98	5.95	2.78
7:15:00	5.31	10.27	8.62	5.16	10.89	8.13	5.73	2.98
7:30:00	5.23	11.07	7.82	5.21	11.06	7.99	5.84	2.78
7:45:00	5.19	10.56	8.78	5.20	10.79	8.10	5.60	2.90
8:00:00	4.91	10.18	8.47	5.14	10.50	8.13	5.36	2.99
8:15:00	4.68	11.4	14.42	5.06	10.70	9.62	5.63	4.56
8:30:00	5.17	9.48	7.3	5.04	10.54	9.36	5.50	4.32
8:45:00	5.06	10.56	8.83	5.00	10.44	9.56	5.43	4.56
9:00:00	4.92	9.69	7.46	4.95	10.26	9.30	5.31	4.35
9:15:00	4.7	9.18	7.58	4.91	10.06	9.12	5.16	4.21
9:30:00	4.69	10.84	9	4.91	9.95	8.03	5.04	3.13
9:45:00	4.51	9.25	8.4	4.78	9.90	8.25	5.13	3.48
10:00:00	4.7	9.17	7.75	4.70	9.63	8.04	4.92	3.33
10:15:00	4.62	9.51	8.28	4.64	9.59	8.20	4.95	3.56
10:30:00	4.98	9.56	8.87	4.70	9.67	8.46	4.97	3.76
10:45:00	4.45	10.6	8.05	4.65	9.62	8.27	4.97	3.62
11:00:00	4.2	11.93	8.79	4.59	10.15	8.35	5.56	3.76
11:15:00	4.55	11.45	11.54	4.56	10.61	9.11	6.05	4.55
11:30:00	4.37	12.84	--	4.51	11.28	9.31	6.77	4.80
11:45:00	4.56	11.33	9.57	4.43	11.63	9.49	7.20	5.06
12:00:00	4.56	12.35	9.21	4.45	11.98	9.78	7.53	5.33
12:15:00	4.71	11.7	7.32	4.55	11.93	9.41	7.38	4.86
12:30:00	5.09	11.04	6.99	4.66	11.85	8.27	7.19	3.61
12:45:00	4.06	11.4	6.96	4.60	11.56	8.01	6.97	3.41
13:00:00	3.64	12.63	6.39	4.41	11.82	7.37	7.41	2.96
13:15:00	3.97	12.77	7.22	4.29	11.91	6.98	7.61	2.68
13:30:00	3.84	10.3	6.79	4.12	11.63	6.87	7.51	2.75
13:45:00	4.21	12.13	7.43	3.94	11.85	6.96	7.90	3.01
14:00:00	4.23	12.3	7.28	3.98	12.03	7.02	8.05	3.04
14:15:00	4.47	10.11	6.48	4.14	11.52	7.04	7.38	2.90
14:30:00	4.29	10.28	7.23	4.21	11.02	7.04	6.82	2.83
14:45:00	4.41	14.23	6.08	4.32	11.81	6.90	7.49	2.58
15:00:00	4.19	11.82	7.56	4.32	11.75	6.93	7.43	2.61
15:15:00	5.74	13.68	8.31	4.62	12.02	7.13	7.40	2.51
15:30:00	4.68	11.33	7.94	4.66	12.27	7.42	7.61	2.76
15:45:00	5.79	17.59	8.78	4.96	13.73	7.73	8.77	2.77
16:00:00	4.85	13.37	8.9	5.05	13.56	8.30	8.51	3.25
16:15:00	6.26	12.81	9.71	5.46	13.76	8.73	8.29	3.26
16:30:00	5.55	10.57	10.56	5.43	13.13	9.18	7.71	3.75
16:45:00	5.14	11	12.53	5.52	13.07	10.10	7.55	4.58
17:00:00	5.28	12.6	12.22	5.42	12.07	10.78	6.65	5.37
17:15:00	4.94	13.35	11.81	5.43	12.07	11.37	6.63	5.93
17:30:00	4.89	15.14	13.52	5.16	12.53	12.13	7.37	6.97
17:45:00	4.44	16.93	14.77	4.94	13.80	12.97	8.87	8.03
18:00:00	4.47	15.72	16.01	4.80	14.75	13.67	9.94	8.86