

**GOWANUS CANAL SUPERFUND SITE
RTA2 REMEDIAL CONSTRUCTION
Water Quality Monitoring Weekly Data Summary**

PERIOD: September 30, 2024 – October 4, 2024

Date of Report: October 7, 2024

Report Contents

- Scope of Monitoring
- Report of Exceedances
- Turbidity Buoy Data
- Dissolved Oxygen Monitoring Data
- Summary of Visual Observations

Prepared by

B&B Engineers & Geologists 
of new york, p.c.

an affiliate of Geosyntec Consultants

1255 Roberts Blvd, Suite 200
Kennesaw, GA 30144
Project Number JR0289B

1. SCOPE OF MONITORING

1.1 Buoy Locations



In accordance with the Water Quality Monitoring Plan for In-waterway Construction Activities (WQMP) issued March 27, 2024, buoys equipped with multi-parameter water quality sondes, were deployed to monitor turbidity related to RTA2 construction activities. Buoys were deployed in the Fourth Street Turning Basin (TB4) to monitor background turbidity unaffected by in-water construction activities and at the North Carroll Street Bridge, which is referred to as the ambient buoy. A sentinel buoy was deployed north of 3rd Street Bridge (3SB), along the west bulkhead. These buoys (Figure 1) are in use to monitor the RTA2 pre-construction activities.

All readings from buoys were transmitted via telemetry at 15-minute intervals. The instrument used to collect turbidity and DO from the buoys is an In-Situ VuLink (telemetry) and AquaTroll500 (sonde), equipped with optical sensors capable of reading turbidity levels with an accuracy of +/-0.5 NTU and DO levels with an accuracy of +/-0.1 mg/L.

1.2 Summary of Monitoring Adjustments during Construction

- August 9, 2024, after the conclusion of RTA1 WQMP, two additional buoys were added to the RTA2 WQMP, for a total of three sentinel buoys. The ambient buoy was moved to approximately ten meters north of Carroll Street Bridge, on the west side of the canal (ambient). A sentinel buoy was placed approximately twenty meters north of 3rd Street Bridge on the west side (3SB). A sentinel buoy was placed in Fourth Street Turning Basin (TB4). The 9th Street Bridge sentinel buoy (9SB) was not moved.
- To reduce instrument downtime, the 9th Street Bridge sentinel buoy (9SB) was relocated to the northeast side of the 9th Street Bridge on August 19, 2024. After two days of data collection, elevated turbidity readings were observed both during and outside of work hours. Consequently, on August 21, 2024, the buoy was moved again, this time to the northeast corner of the Hamilton Street Bridge.
- Turbidity readings at the Hamilton Street Bridge location exceeded 100 NTU both during and outside working hours. However, these readings were not representative of the actual turbidity within the RTA2 work area. Due to commercial traffic, a safe location for the sonde and buoy could not be found south of the 9th Street Bridge. Consequently, the sonde and buoy were relocated to the west side, 5 meters north of the 9th Street Bridge on Tuesday August 27, 2024, at 08:15.
- Turbidity readings at 9SB were noted to be erratic and exceed 100 NTU both during and outside working hours. The buoy was moved approximately 20 meters north of 9th Street Bridge on Monday September 9, 2024.

- September 16, 2024, the 9SB was deselected from construction monitoring, as there is no construction activities in the main canal or in the vicinity of 9th Street Bridge. The buoy will remain in the water to collect background data as it is believed this area has naturally high NTU readings. A spot check zero calibration was performed on the buoy Wednesday September 18 to confirm the sensors were reading properly during this background monitoring period.

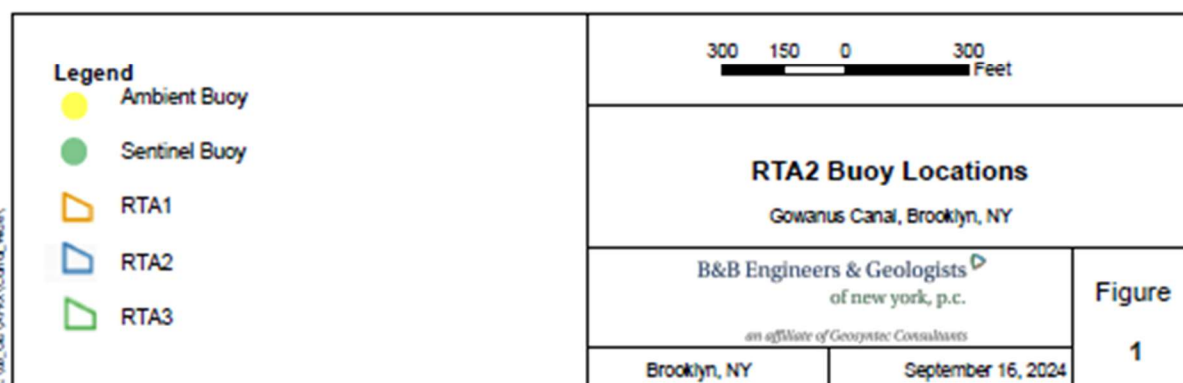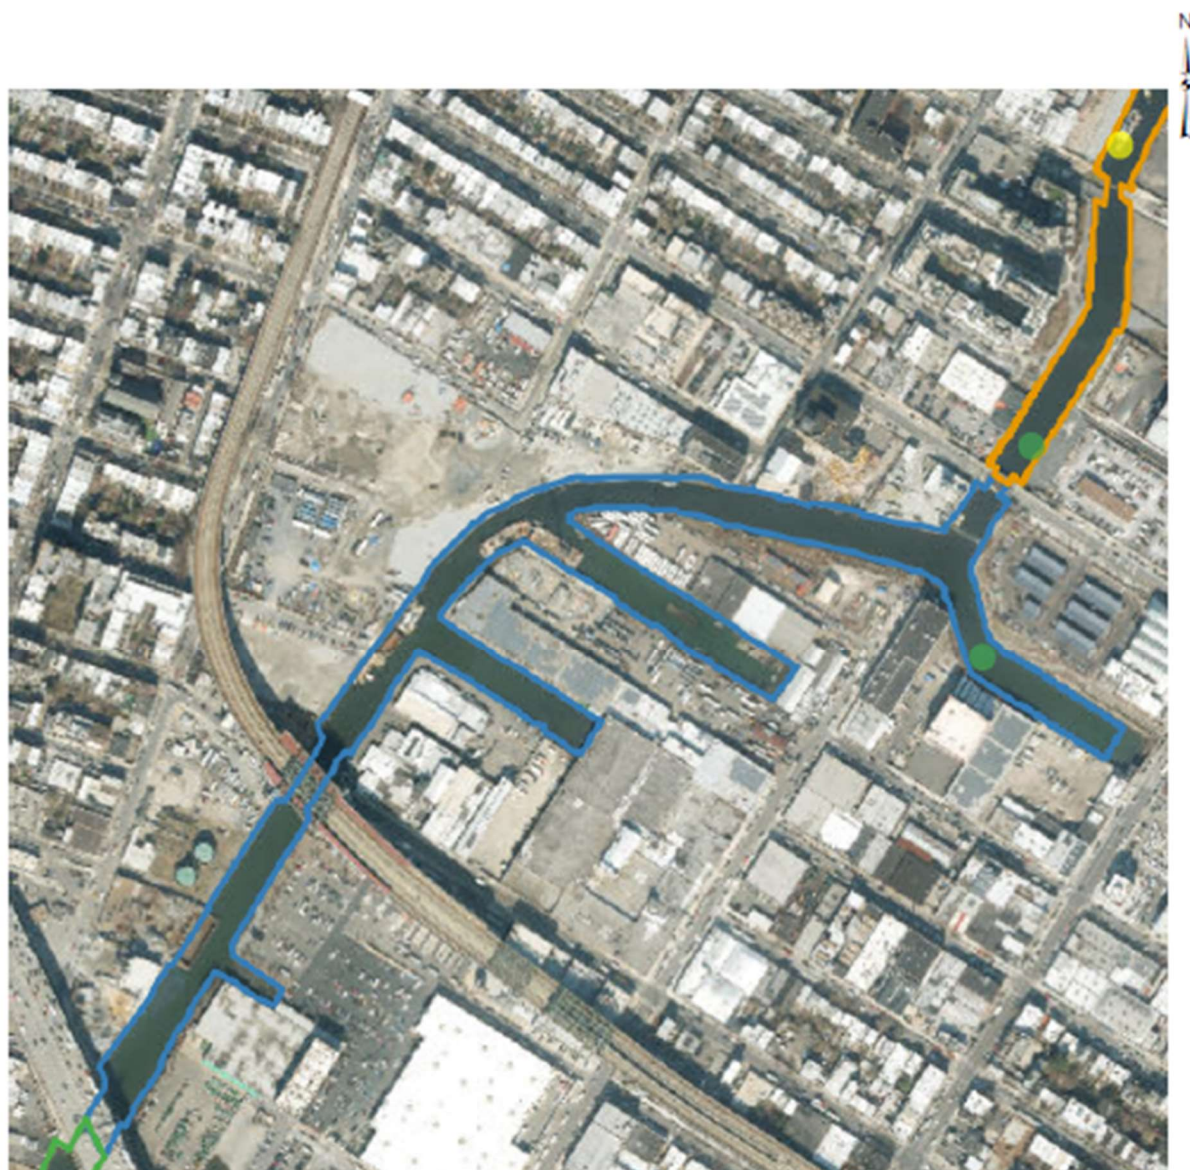

1.3 Current Reporting Period Scope of Monitoring

During the week of September 30, 2024, three buoys equipped with multi-parameter water quality sondes were deployed as described in Section 1.2. However, due to bulkhead installation activities, these buoys were inaccessible until Friday, October 4, as barges blocked the boat access needed for cleaning and maintenance. The ambient sonde batteries were exhausted on October 2 at 05:30; no data was recorded between October 2 at 05:30 and October 4 at 12:30. All sondes and buoys were cleaned, and all sonde batteries were replaced on Friday, October 4, between 12:00 and 13:00.

All readings from buoys were transmitted via telemetry at 15-minute intervals. The instrument used to collect turbidity and DO from the buoys is an In-Situ VuLink (telemetry) and AquaTroll500 (sonde), equipped with optical sensors capable of reading turbidity levels with an accuracy of +/-0.5 NTU and DO levels with an accuracy of +/-0.1 mg/L.

Visual observations of turbidity and sheen are summarized in Section 5.

1.4 Meteorological Conditions

The weather conditions onsite were as follows:

Table 1 - Summary of Weather Conditions for reporting period.

Meteorological Parameters	09/30/2024	10/01/2024	10/02/2024	10/03/2024	10/04/2024
<i>Wind Direction (from)</i>	ENE	ENE	E	SSW	SSW
<i>Wind Speed (mph)</i>	4.9	5.1	4.2	3.9	4.4
<i>Temperature (°F)</i>	64.7	63.8	62.2	65.0	65.7
<i>Humidity (%)</i>	80.1	80.1	79.3	76.9	80.9
<i>Barometric Pressure (inHg)</i>	29.96	29.96	29.92	30.04	30.09
<i>Precipitation (Inch)</i>	0	0	0	0	0

1.5 Tidal Conditions

Tidal data from the Battery (National Oceanic and Atmospheric Administration [NOAA] Station 8518750) was reviewed and is summarized as follows:

Table 2 - NOAA Preliminary observations and predictions.

Date	Time	Predicted NAV88 (Ft)	Preliminary Reported NAV88 (ft)	High/Low
Monday, September 30, 2024	1:25	-2.3	-1.28	L
Monday, September 30, 2024	7:30	2.2	3.12	H
Monday, September 30, 2024	13:35	-2.05	-1.05	L
Monday, September 30, 2024	19:42	2.31	3.21	H
Tuesday, October 1, 2024	2:03	-2.38	-1.35	L
Tuesday, October 1, 2024	8:07	2.4	3.17	H
Tuesday, October 1, 2024	14:17	-2.17	-1.42	L
Tuesday, October 1, 2024	20:18	2.3	3.16	H
Wednesday, October 2, 2024	2:40	-2.41	-0.97	L
Wednesday, October 2, 2024	8:42	2.53	3.48	H
Wednesday, October 2, 2024	14:58	-2.24	-1.13	L
Wednesday, October 2, 2024	20:52	2.22	3.02	H
Thursday, October 3, 2024	3:14	-2.38	-1.4	L
Thursday, October 3, 2024	9:15	2.57	3.11	H
Thursday, October 3, 2024	15:37	-2.25	-1.53	L
Thursday, October 3, 2024	21:24	2.06	2.68	H
Friday, October 4, 2024	3:47	-2.3	-1.69	L
Friday, October 4, 2024	9:46	2.53	2.94	H
Friday, October 4, 2024	16:15	-2.21	-1.72	L
Friday, October 4, 2024	21:56	1.86	2.44	H

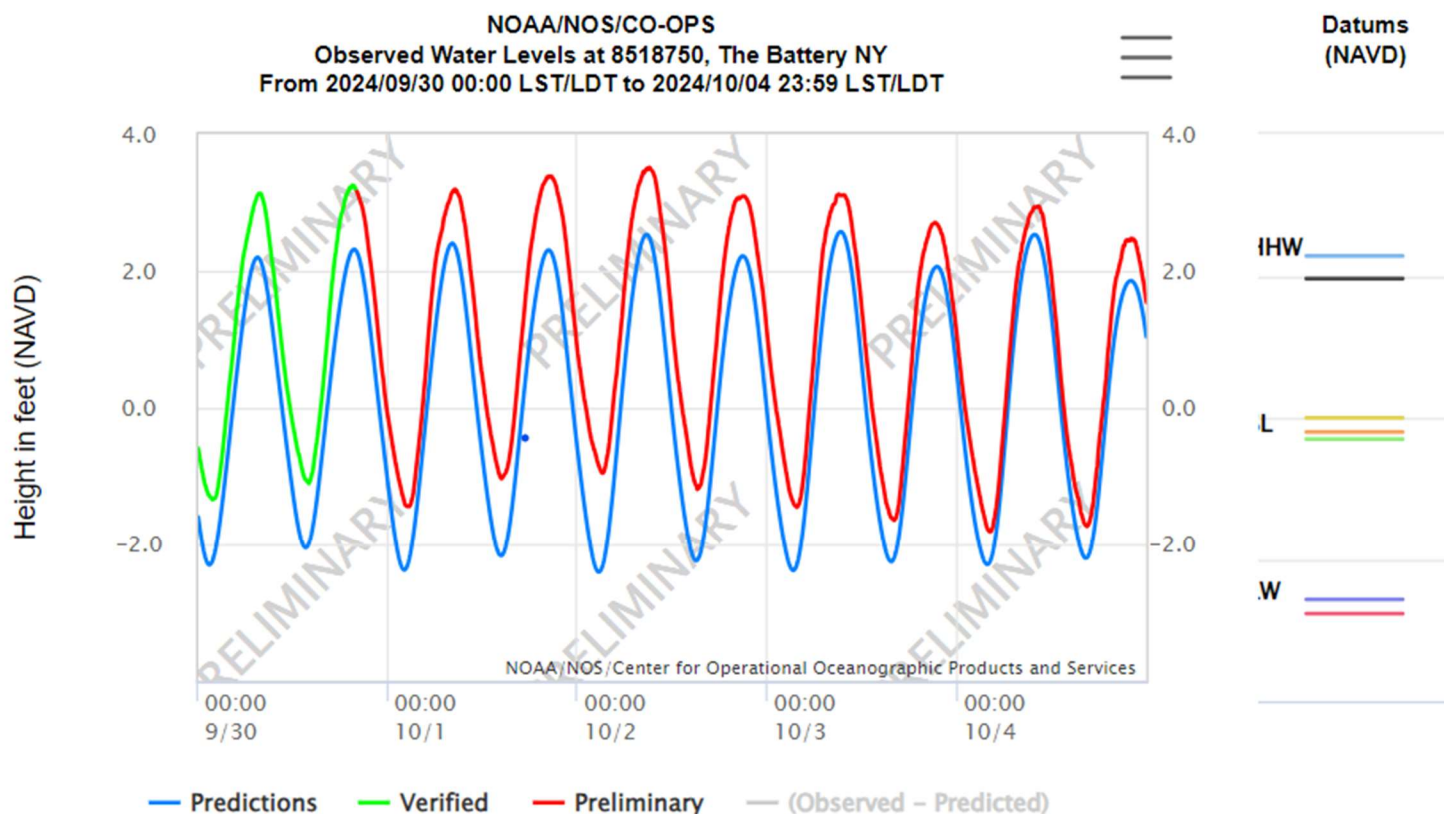


Figure 2 - Tidal Chart for reporting period.

2. REPORT OF EXCEEDANCES

No exceedances of the trigger or action criteria were observed during the reporting period due to construction activities. No data was recorded at the ambient sonde between October 2 at 5:30 AM and October 4 at 12:30 PM. This sonde and buoy, located in RTA1, are intended to monitor background turbidity unaffected by in-water construction activities. The 3rd Street sonde, also located in RTA1 just north of RTA2, did not record any elevated readings during the ambient sonde's downtime.

Turbidity and floatables were observed throughout the reporting period unrelated to construction activities.

- **Trigger criterion** – Any of the following:
 - The rolling average of the relevant sentinel buoy turbidity measurements over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 20 NTU excluding any eliminated outlier measurements and in-waterway construction activities cannot be immediately excluded as the source following consultation with EPA; or
 - Either an oil sheen or a turbidity plume is visually observed at the relevant sentinel buoy and in-waterway construction activities are readily identified as the source.

- **Action criterion** – Any of the following:
 - The rolling average of the turbidity measurements of the sentinel buoy outside of RTA2 over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 40 NTU excluding any eliminated outlier measurements and in-waterway construction activities cannot be immediately excluded as the source following consultation with EPA; or
 - Either an oil sheen or a turbidity plume is visually observed outside of RTA2, and any deployed engineering controls and in-waterway construction activities are readily identified as the source.

An outlier is defined as a reading that is outside the range of 50 to 200 percent of the average of the three previous readings. In addition, to be considered an outlier, the subsequent reading must return to a range of 75 to 133 percent of the average of the three readings preceding the outlier.

2.1 Response to Criteria Exceedances

The trigger level criterion serves to provide early notification to the contractor of construction activities that may lead to an exceedance of the action level criterion. In the event of an exceedance to the trigger criterion, the contractor will not be stopped, and the contractor will be directed to investigate the source of the exceedance and evaluate Best Management Practices (BMPs). In the event of an exceedance to the action level criterion, in-waterway construction activities may be slowed or temporarily suspended as necessary while the contractor investigates the source of the exceedance and appropriate mitigation, and corrective measures are determined. A more detailed description of responses to exceedances of the trigger and action level criteria is provided in Section 4.2 of the WQMP.

3. TURBIDITY BUOY DATA

Throughout the reporting period, readings at the Ambient, TB4, and 3SB sondes remained relatively stable. During the ambient sonde's instrument downtime, the trigger and action level criteria were set to 20 NTU and 40 NTU, respectively.

3.1 Monday, September 30, 2024

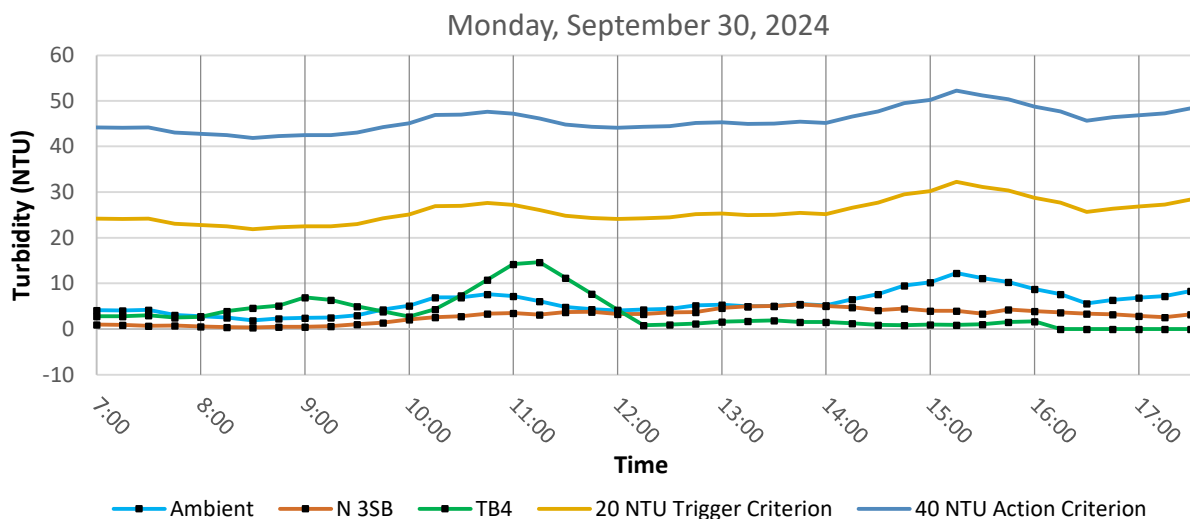


Figure 3. Hourly rolling average turbidity readings from 07:00 to 17:30

3.2 Tuesday, October 1, 2024


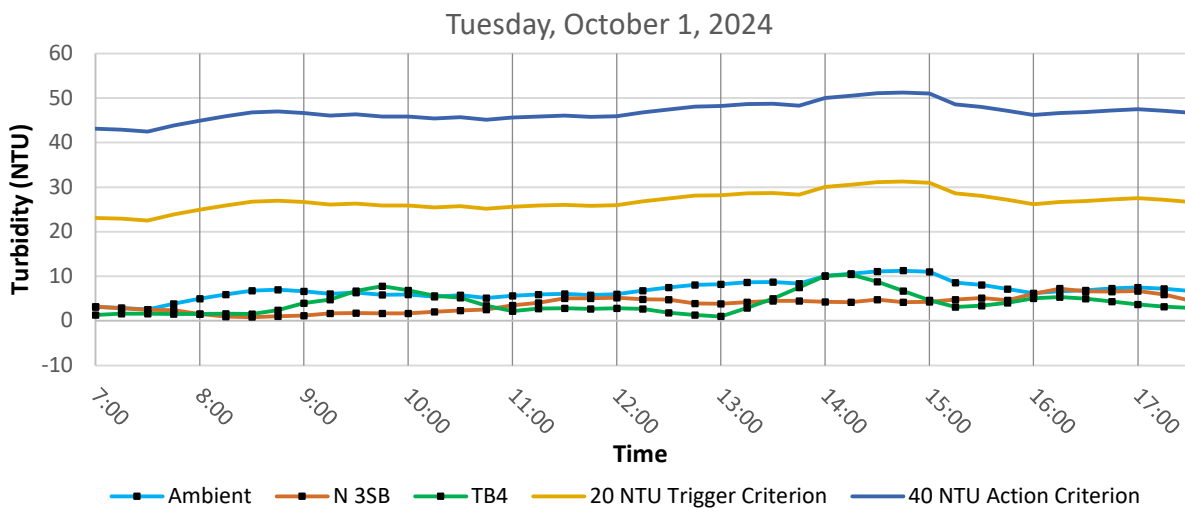


Figure 4. Hourly rolling average turbidity readings from 07:00 to 17:30


3.3 Wednesday, October 2, 2024

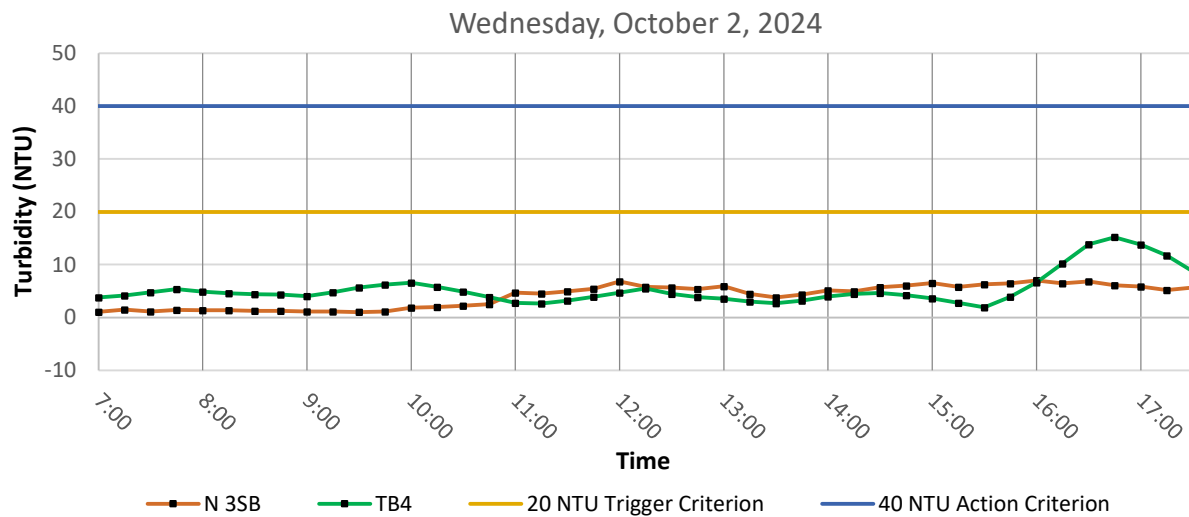

Note: The ambient sonde lost power, and no data was recorded until 12:30 on October 4. Trigger and action level criteria were set at 20 NTU and 40 NTU during this time.

Figure 5. Hourly rolling average turbidity readings from 07:00 to 17:30


3.4 Thursday, October 3, 2024

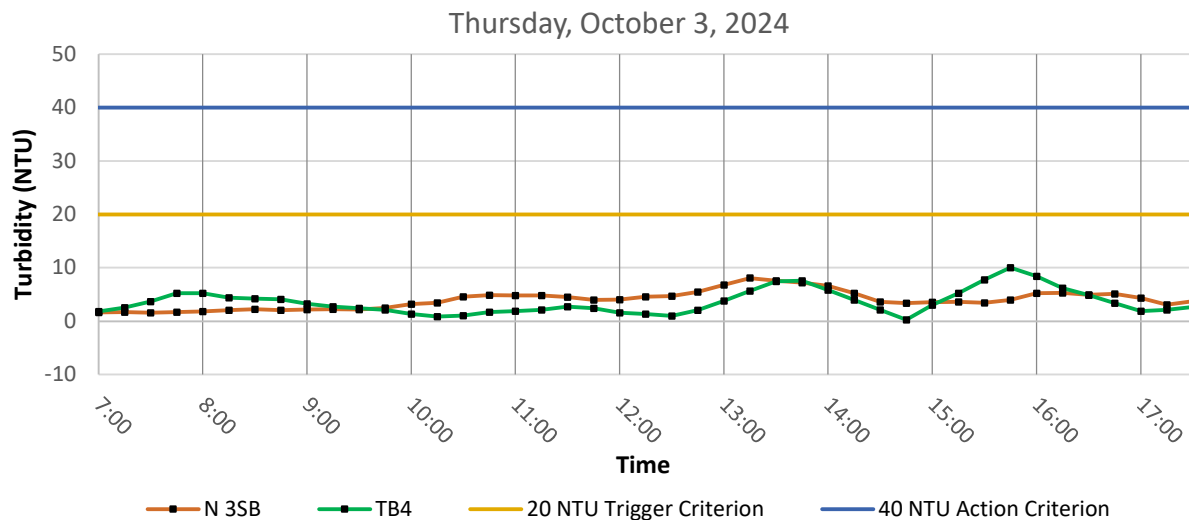

Note: The ambient sonde lost power, and no data was recorded 12:30 on October 4. Trigger and action level criteria were set at 20 NTU and 40 NTU during this time.

Figure 6. Hourly rolling average turbidity readings from 07:00 to 17:30

3.5 Friday, October 3, 2024

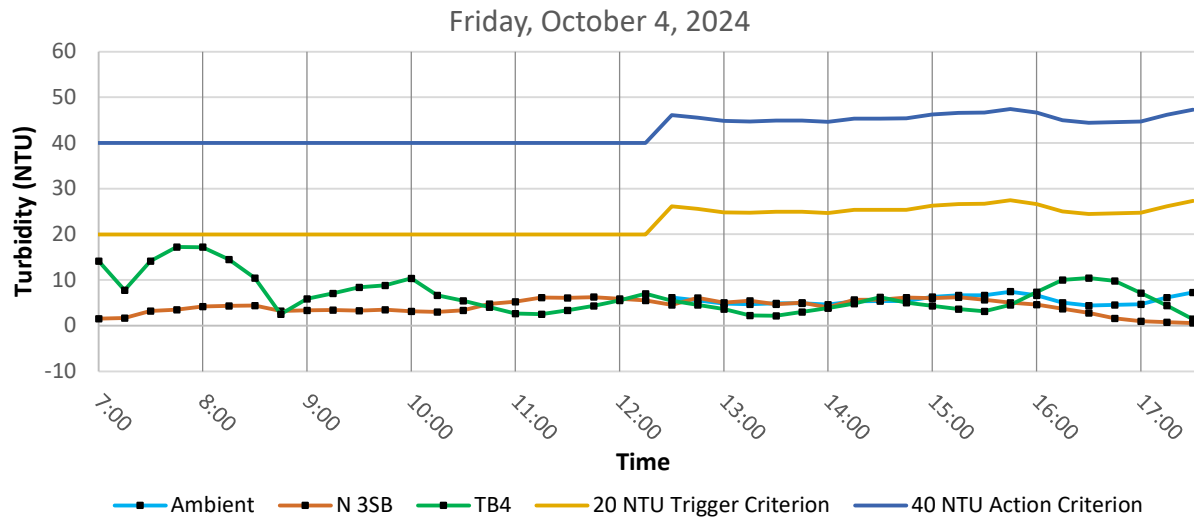

Note: The ambient sonde lost power, and no data was recorded until 12:30. Trigger and action level criteria were set at 20 NTU and 40 NTU during this time.

Figure 7. Hourly rolling average turbidity readings from 07:00 to 16:30

4. SUMMARY OF VISUAL OBSERVATIONS

Throughout the reporting period, sheens in the RTA2 areas ranged from minimal to moderate. During work activities, one turbidity curtain was deployed in the Turning Basin 4. The turbidity curtain approximately 15 meters north of 3rd Street bridge detached from the bulkhead between September 28 and September 30. The turbidity curtain could not be corrected as the barges associated with the bulkhead installation activities were blocking the canal. The 3rd Street turbidity curtain was restored at approximately 15:30 on Friday, October 4.

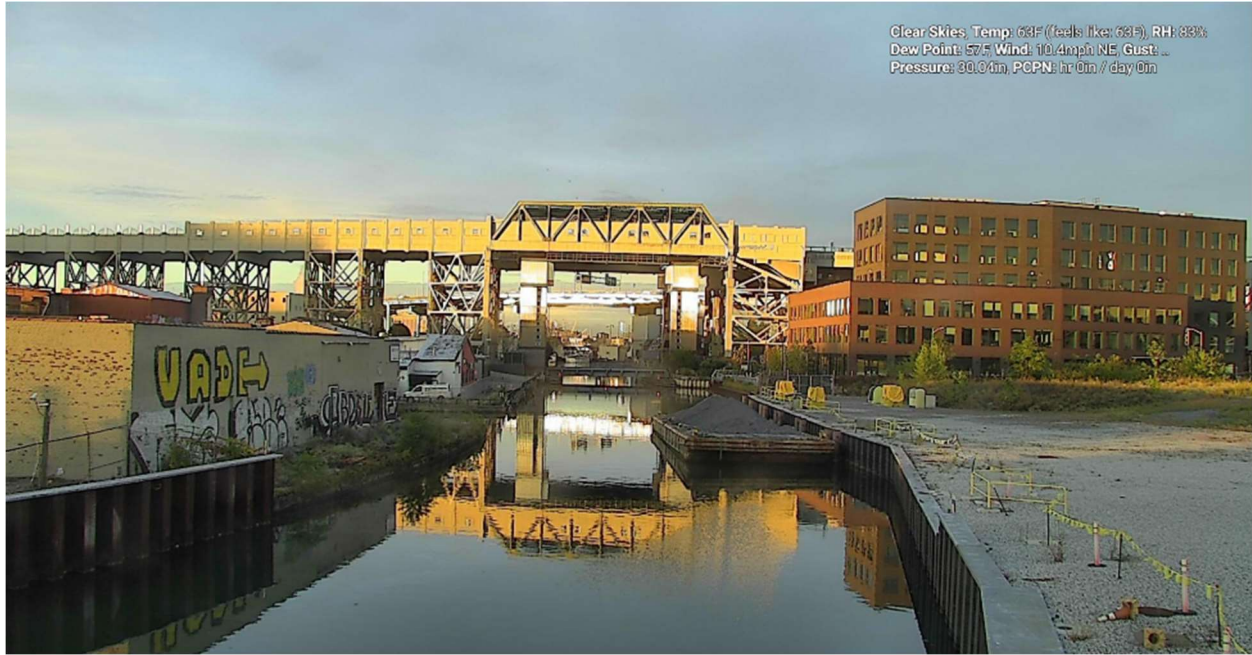


Figure 8 – September 30, 2024. General Conditions in Canal north of 9th Street Bridge prior to work activities at 06:52. Light sheens noted.



Figure 9– October 2, 2024. General Conditions in Canal south of 3rd Street Bridge at 07:02. No sheens noted. Entirety of canal is blocked by equipment and material barges.



Figure 10 – October 3, 2024. General Conditions in Canal north of 9th Street Bridge prior to work activities at 07:07. Light sheens noted.

APPENDIX A

Turbidity Data Tables

Table 3

Monday, September 30, 2024

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	TB4	Ambient	N3SB	TB4	N3SB - Ambient	TB4 - Ambient
9/30/2024	7:00:00	2.88	1.11	1.89	4.14	0.97	2.76	-3.17	-1.39
9/30/2024	7:15:00	3.85	0.56	2.78	4.08	0.87	2.76	-3.22	-1.32
9/30/2024	7:30:00	2.91	0.00	3.35	4.19	0.69	2.99	-3.50	-1.20
9/30/2024	7:45:00	1.86	0.71	0.54	3.06	0.73	2.54	-2.33	-0.52
9/30/2024	8:00:00	2.38	0.42	4.76	2.78	0.56	2.66	-2.22	-0.11
9/30/2024	8:15:00	1.57	0.17	8.19	2.51	0.37	3.92	-2.14	1.41
9/30/2024	8:30:00	0.67	0.41	6.14	1.88	0.34	4.59	-1.54	2.72
9/30/2024	8:45:00	4.99	0.67	5.84	2.29	0.47	5.09	-1.82	2.80
9/30/2024	9:00:00	2.74	0.63	9.55	2.47	0.46	6.90	-2.01	4.42
9/30/2024	9:15:00	--	1.17	2.11	2.49	0.61	6.37	-1.89	3.87
9/30/2024	9:30:00	3.67	2.27	1.09	3.02	1.03	4.95	-1.99	1.93
9/30/2024	9:45:00	5.62	2.27	0.68	4.25	1.40	3.86	-2.85	-0.40
9/30/2024	10:00:00	8.41	4.22	0.00	5.11	2.11	2.69	-3.00	-2.42
9/30/2024	10:15:00	9.94	2.95	17.61	6.91	2.57	4.30	-4.33	-2.61
9/30/2024	10:30:00	7.17	2.28	17.39	6.96	2.80	7.36	-4.16	0.40
9/30/2024	10:45:00	6.93	5.07	18.31	7.61	3.36	10.80	-4.26	3.19
9/30/2024	11:00:00	3.51	3.00	17.93	7.19	3.50	14.25	-3.69	7.06
9/30/2024	11:15:00	2.97	2.25	2.03	6.10	3.11	14.66	-2.99	8.55
9/30/2024	11:30:00	3.47	5.90	0.22	4.81	3.70	11.18	-1.11	6.37
9/30/2024	11:45:00	4.61	2.47	0.00	4.30	3.74	7.70	-0.56	3.40
9/30/2024	12:00:00	5.86	2.73	0.73	4.08	3.27	4.18	-0.81	0.10
9/30/2024	12:15:00	4.49	3.12	1.00	4.28	3.29	0.80	-0.99	-3.48
9/30/2024	12:30:00	3.71	3.90	2.84	4.43	3.62	0.96	-0.80	-3.47
9/30/2024	12:45:00	7.13	6.31	1.37	5.16	3.71	1.19	-1.45	-3.97
9/30/2024	13:00:00	5.36	6.92	1.91	5.31	4.60	1.57	-0.72	-3.74
9/30/2024	13:15:00	3.95	4.62	1.58	4.93	4.97	1.74	0.04	-3.19
9/30/2024	13:30:00	4.91	3.56	1.64	5.01	5.06	1.87	0.05	-3.14
9/30/2024	13:45:00	5.77	5.68	0.96	5.42	5.42	1.49	-0.01	-3.93
9/30/2024	14:00:00	5.81	4.24	1.36	5.16	5.00	1.49	-0.16	-3.67
9/30/2024	14:15:00	12.20	5.84	0.53	6.53	4.79	1.22	-1.74	-5.31
9/30/2024	14:30:00	9.56	1.36	0.03	7.65	4.14	0.91	-3.51	-6.74
9/30/2024	14:45:00	14.20	5.18	1.41	9.51	4.46	0.86	-5.05	-8.65
9/30/2024	15:00:00	9.36	3.41	1.64	10.23	4.01	0.99	-6.22	-9.23
9/30/2024	15:15:00	16.13	--	--	12.29	3.95	0.90	-8.34	-11.39
9/30/2024	15:30:00	6.47	3.48	--	11.14	3.36	1.03	-7.79	-10.12
9/30/2024	15:45:00	5.47	4.91	--	10.33	4.25	1.52	-6.08	-8.80
9/30/2024	16:00:00	6.18	3.82	--	8.72	3.91	1.64	-4.82	-7.08
9/30/2024	16:15:00	4.06	2.17	--	7.66	3.60	--	-4.07	--
9/30/2024	16:30:00	5.92	2.20	--	5.62	3.32	--	-2.30	--
9/30/2024	16:45:00	10.29	2.82	--	6.38	3.18	--	-3.20	--
9/30/2024	17:00:00	7.81	3.14	--	6.85	2.83	--	-4.02	--
9/30/2024	17:15:00	8.08	2.62	--	7.23	2.59	--	-4.64	--
9/30/2024	17:30:00	9.70	5.33	--	8.36	3.22	--	-5.14	--

Table 4

Tuesday, October 1, 2024

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	TB4	Ambient	N3SB	TB4	N3SB - Ambient	TB4 - Ambient
10/1/2024	7:00:00	1.98	4.23	1.71	3.10	3.14	1.31	0.04	-1.79
10/1/2024	7:15:00	2.12	1.65	2.46	2.91	2.77	1.60	-0.13	-1.31
10/1/2024	7:30:00	3.63	1.06	--	2.53	2.43	1.60	-0.10	-0.93
10/1/2024	7:45:00	8.89	0.32	0.81	3.84	2.34	1.48	-1.50	-2.36
10/1/2024	8:00:00	8.06	0.17	0.95	4.94	1.49	1.48	-3.45	-3.46
10/1/2024	8:15:00	6.78	1.53	1.97	5.90	0.95	1.55	-4.95	-4.35
10/1/2024	8:30:00	6.45	1.19	2.19	6.76	0.85	1.48	-5.91	-5.29
10/1/2024	8:45:00	4.64	1.92	5.98	6.97	1.02	2.38	-5.94	-4.59
10/1/2024	9:00:00	7.29	1.02	8.60	6.65	1.17	3.94	-5.48	-2.71
10/1/2024	9:15:00	5.14	2.69	5.14	6.06	1.67	4.78	-4.39	-1.29
10/1/2024	9:30:00	8.05	1.92	11.34	6.31	1.75	6.65	-4.57	0.33
10/1/2024	9:45:00	4.07	0.79	7.75	5.84	1.67	7.76	-4.17	1.92
10/1/2024	10:00:00	4.74	2.01	1.24	5.86	1.69	6.81	-4.17	0.96
10/1/2024	10:15:00	5.10	2.50	2.39	5.42	1.98	5.57	-3.44	0.15
10/1/2024	10:30:00	6.62	4.13	3.21	5.72	2.27	5.19	-3.45	-0.53
10/1/2024	10:45:00	--	2.97	2.16	5.13	2.48	3.35	-2.65	-1.78
10/1/2024	11:00:00	6.00	5.52	1.79	5.62	3.43	2.16	-2.19	-3.46
10/1/2024	11:15:00	5.71	5.08	3.96	5.86	4.04	2.70	-1.82	-3.16
10/1/2024	11:30:00	5.77	7.59	2.73	6.03	5.06	2.77	-0.97	-3.26
10/1/2024	11:45:00	5.63	4.12	2.72	5.78	5.05	2.67	-0.73	-3.11
10/1/2024	12:00:00	6.55	3.64	--	5.93	5.19	2.80	-0.74	-3.13
10/1/2024	12:15:00	10.28	3.55	1.34	6.79	4.79	2.69	-1.99	-4.10
10/1/2024	12:30:00	8.99	--	0.51	7.44	4.72	1.82	-2.72	-5.62
10/1/2024	12:45:00	8.92	4.31	0.74	8.07	3.90	1.33	-4.17	-6.75
10/1/2024	13:00:00	6.27	3.85	1.38	8.20	3.84	0.99	-4.36	-7.21
10/1/2024	13:15:00	8.72	4.88	10.40	8.63	4.15	2.87	-4.49	-5.76
10/1/2024	13:30:00	10.55	4.85	11.67	8.69	4.47	4.94	-4.21	-3.75
10/1/2024	13:45:00	7.10	--	13.05	8.31	4.47	7.45	-3.84	-0.86
10/1/2024	14:00:00	17.51	3.47	13.76	10.03	4.26	10.05	-5.77	0.02
10/1/2024	14:15:00	8.80	3.35	3.13	10.54	4.14	10.40	-6.40	-0.14
10/1/2024	14:30:00	11.47	7.33	2.39	11.09	4.75	8.80	-6.34	-2.29
10/1/2024	14:45:00	11.49	2.65	1.08	11.27	4.20	6.68	-7.07	-4.59
10/1/2024	15:00:00	5.71	4.57	2.52	10.99	4.28	4.57	-6.72	-6.42
10/1/2024	15:15:00	5.47	5.78	6.22	8.59	4.74	3.07	-3.85	-5.52
10/1/2024	15:30:00	5.97	--	4.80	8.02	5.08	3.40	-2.94	-4.62
10/1/2024	15:45:00	7.06	5.34	5.47	7.14	4.58	4.02	-2.56	-3.12
10/1/2024	16:00:00	6.71	8.57	5.99	6.18	6.06	5.00	-0.12	-1.18
10/1/2024	16:15:00	8.03	9.21	4.10	6.65	7.22	5.32	0.58	-1.33
10/1/2024	16:30:00	6.54	3.21	4.33	6.86	6.58	4.94	-0.28	-1.92
10/1/2024	16:45:00	7.83	6.45	1.53	7.23	6.55	4.29	-0.68	-2.95
10/1/2024	17:00:00	8.32	6.16	2.43	7.49	6.72	3.68	-0.77	-3.81
10/1/2024	17:15:00	5.13	4.42	3.29	7.17	5.89	3.14	-1.28	-4.03
10/1/2024	17:30:00	5.57	2.25	--	6.68	4.50	2.90	-2.18	-3.78

Table 5

Wednesday, October 2, 2024

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	TB4	Ambient	N3SB	TB4	N3SB - Ambient	TB4 - Ambient
10/2/2024	7:00:00	--	1.08	3.79	--	1.08	3.79	--	--
10/2/2024	7:15:00	--	1.91	4.51	--	1.49	4.15	--	--
10/2/2024	7:30:00	--	0.47	6.00	--	1.15	4.76	--	--
10/2/2024	7:45:00	--	2.21	7.25	--	1.42	5.38	--	--
10/2/2024	8:00:00	--	1.31	2.73	--	1.39	4.85	--	--
10/2/2024	8:15:00	--	1.01	2.41	--	1.38	4.58	--	--
10/2/2024	8:30:00	--	1.20	3.60	--	1.24	4.40	--	--
10/2/2024	8:45:00	--	0.42	5.79	--	1.23	4.36	--	--
10/2/2024	9:00:00	--	1.56	5.75	--	1.10	4.06	--	--
10/2/2024	9:15:00	--	1.35	6.28	--	1.11	4.77	--	--
10/2/2024	9:30:00	--	0.74	6.99	--	1.05	5.68	--	--
10/2/2024	9:45:00	--	1.59	6.38	--	1.13	6.24	--	--
10/2/2024	10:00:00	--	4.07	7.57	--	1.86	6.59	--	--
10/2/2024	10:15:00	--	2.21	1.77	--	1.99	5.80	--	--
10/2/2024	10:30:00	--	2.60	1.75	--	2.24	4.89	--	--
10/2/2024	10:45:00	--	2.10	1.81	--	2.51	3.86	--	--
10/2/2024	11:00:00	--	12.46	1.05	--	4.69	2.79	--	--
10/2/2024	11:15:00	--	3.22	6.70	--	4.52	2.62	--	--
10/2/2024	11:30:00	--	4.44	4.53	--	4.96	3.17	--	--
10/2/2024	11:45:00	--	4.78	5.57	--	5.40	3.93	--	--
10/2/2024	12:00:00	--	9.15	5.55	--	6.81	4.68	--	--
10/2/2024	12:15:00	--	7.30	5.16	--	5.78	5.50	--	--
10/2/2024	12:30:00	--	2.56	1.36	--	5.64	4.43	--	--
10/2/2024	12:45:00	--	2.96	1.77	--	5.35	3.88	--	--
10/2/2024	13:00:00	--	7.61	3.78	--	5.91	3.52	--	--
10/2/2024	13:15:00	--	1.82	2.81	--	4.45	2.97	--	--
10/2/2024	13:30:00	--	4.00	3.91	--	3.79	2.72	--	--
10/2/2024	13:45:00	--	5.30	3.72	--	4.34	3.20	--	--
10/2/2024	14:00:00	--	6.76	5.57	--	5.10	3.96	--	--
10/2/2024	14:15:00	--	6.91	6.34	--	4.96	4.47	--	--
10/2/2024	14:30:00	--	--	3.69	--	5.74	4.64	--	--
10/2/2024	14:45:00	--	5.15	1.60	--	6.03	4.18	--	--
10/2/2024	15:00:00	--	7.19	0.83	--	6.50	3.61	--	--
10/2/2024	15:15:00	--	3.79	1.41	--	5.76	2.77	--	--
10/2/2024	15:30:00	--	9.00	2.06	--	6.28	1.92	--	--
10/2/2024	15:45:00	--	7.27	13.81	--	6.48	3.94	--	--
10/2/2024	16:00:00	--	8.02	14.98	--	7.06	6.62	--	--
10/2/2024	16:15:00	--	4.10	18.85	--	6.44	10.22	--	--
10/2/2024	16:30:00	--	5.63	19.41	--	6.80	13.82	--	--
10/2/2024	16:45:00	--	5.43	9.04	--	6.09	15.22	--	--
10/2/2024	17:00:00	--	6.20	6.72	--	5.88	13.80	--	--
10/2/2024	17:15:00	--	4.43	4.44	--	5.16	11.69	--	--
10/2/2024	17:30:00	--	6.51	3.71	--	5.64	8.67	--	--

Table 6

Thursday, October 3, 2024

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	TB4	Ambient	N3SB	TB4	N3SB - Ambient	TB4 - Ambient
10/3/2024	7:00:00	--	1.80	6.57	--	1.64	1.80	--	--
10/3/2024	7:15:00	--	1.61	2.83	--	1.70	2.51	--	--
10/3/2024	7:30:00	--	--	4.60	--	1.57	3.66	--	--
10/3/2024	7:45:00	--	1.74	6.88	--	1.70	5.22	--	--
10/3/2024	8:00:00	--	1.97	5.38	--	1.78	5.25	--	--
10/3/2024	8:15:00	--	2.91	2.16	--	2.06	4.37	--	--
10/3/2024	8:30:00	--	--	2.09	--	2.21	4.22	--	--
10/3/2024	8:45:00	--	1.59	3.90	--	2.05	4.08	--	--
10/3/2024	9:00:00	--	2.20	2.65	--	2.17	3.24	--	--
10/3/2024	9:15:00	--	2.21	--	--	2.23	2.70	--	--
10/3/2024	9:30:00	--	2.59	0.92	--	2.15	2.39	--	--
10/3/2024	9:45:00	--	3.69	0.93	--	2.45	2.10	--	--
10/3/2024	10:00:00	--	5.18	0.82	--	3.17	1.33	--	--
10/3/2024	10:15:00	--	3.59	0.67	--	3.45	0.83	--	--
10/3/2024	10:30:00	--	7.72	1.95	--	4.55	1.06	--	--
10/3/2024	10:45:00	--	4.16	4.11	--	4.87	1.70	--	--
10/3/2024	11:00:00	--	3.40	1.91	--	4.81	1.89	--	--
10/3/2024	11:15:00	--	5.08	1.99	--	4.79	2.13	--	--
10/3/2024	11:30:00	--	2.16	3.61	--	4.50	2.71	--	--
10/3/2024	11:45:00	--	4.95	0.32	--	3.95	2.39	--	--
10/3/2024	12:00:00	--	4.44	0.10	--	4.00	1.58	--	--
10/3/2024	12:15:00	--	6.14	0.59	--	4.55	1.32	--	--
10/3/2024	12:30:00	--	5.61	0.20	--	4.66	0.96	--	--
10/3/2024	12:45:00	--	6.22	8.91	--	5.47	2.02	--	--
10/3/2024	13:00:00	--	11.52	9.12	--	6.79	3.78	--	--
10/3/2024	13:15:00	--	10.93	9.38	--	8.08	5.64	--	--
10/3/2024	13:30:00	--	3.57	9.51	--	7.57	7.43	--	--
10/3/2024	13:45:00	--	3.91	1.02	--	7.23	7.59	--	--
10/3/2024	14:00:00	--	3.20	0.00	--	6.62	5.81	--	--
10/3/2024	14:15:00	--	4.42	0.00	--	5.20	3.98	--	--
10/3/2024	14:30:00	--	2.97	0.00	--	3.61	2.11	--	--
10/3/2024	14:45:00	--	2.38	--	--	3.38	0.26	--	--
10/3/2024	15:00:00	--	4.75	11.97	--	3.54	2.99	--	--
10/3/2024	15:15:00	--	--	8.83	--	3.63	5.20	--	--
10/3/2024	15:30:00	--	3.61	10.06	--	3.43	7.72	--	--

Table 7

Friday, October 4, 2024

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	TB4	Ambient	N3SB	TB4	N3SB - Ambient	TB4 - Ambient
10/4/2024	7:00:00	--	1.97	12.56	--	1.50	14.14	--	--
10/4/2024	7:15:00	--	1.95	21.09	--	1.66	7.78	--	--
10/4/2024	7:30:00	--	9.73	33.86	--	3.17	14.14	--	--
10/4/2024	7:45:00	--	3.05	--	--	3.45	17.18	--	--
10/4/2024	8:00:00	--	4.03	1.21	--	4.15	17.18	--	--
10/4/2024	8:15:00	--	2.71	1.80	--	4.29	14.49	--	--
10/4/2024	8:30:00	--	2.38	4.90	--	4.38	10.44	--	--
10/4/2024	8:45:00	--	3.95	1.95	--	3.22	2.47	--	--
10/4/2024	9:00:00	--	3.54	19.59	--	3.32	5.89	--	--
10/4/2024	9:15:00	--	4.34	7.01	--	3.38	7.05	--	--
10/4/2024	9:30:00	--	2.05	8.36	--	3.25	8.36	--	--
10/4/2024	9:45:00	--	--	7.11	--	3.47	8.80	--	--
10/4/2024	10:00:00	--	2.56	9.52	--	3.12	10.32	--	--
10/4/2024	10:15:00	--	2.89	1.14	--	2.96	6.63	--	--
10/4/2024	10:30:00	--	5.84	1.02	--	3.34	5.43	--	--
10/4/2024	10:45:00	--	7.79	1.35	--	4.77	4.03	--	--
10/4/2024	11:00:00	--	7.12	0.09	--	5.24	2.62	--	--
10/4/2024	11:15:00	--	7.20	8.70	--	6.17	2.46	--	--
10/4/2024	11:30:00	--	2.55	5.60	--	6.10	3.35	--	--
10/4/2024	11:45:00	--	6.67	5.81	--	6.27	4.31	--	--
10/4/2024	12:00:00	--	--	7.34	--	5.89	5.51	--	--
10/4/2024	12:15:00	--	5.51	7.33	--	5.48	6.96	--	--
10/4/2024	12:30:00	6.10	3.25	1.12	6.10	4.49	5.44	-0.66	-0.66
10/4/2024	12:45:00	4.95	8.81	1.18	5.53	6.06	4.56	-0.97	-0.97
10/4/2024	13:00:00	3.36	2.55	0.94	4.80	5.03	3.58	-1.22	-1.22
10/4/2024	13:15:00	4.33	6.96	0.60	4.69	5.42	2.23	-2.45	-2.45
10/4/2024	13:30:00	5.72	1.78	6.97	4.89	4.67	2.16	-2.73	-2.73
10/4/2024	13:45:00	6.11	--	5.35	4.89	5.03	3.01	-1.89	-1.89
10/4/2024	14:00:00	3.63	4.47	5.13	4.63	3.94	3.80	-0.83	-0.83
10/4/2024	14:15:00	6.82	9.24	5.95	5.32	5.61	4.80	-0.52	-0.52
10/4/2024	14:30:00	4.44	7.19	7.58	5.34	5.67	6.20	0.85	0.85
10/4/2024	14:45:00	5.79	3.62	1.15	5.36	6.13	5.03	-0.32	-0.32
10/4/2024	15:00:00	10.60	5.51	1.81	6.25	6.01	4.33	-1.93	-1.93
10/4/2024	15:15:00	5.40	5.45	1.62	6.61	6.20	3.62	-2.99	-2.99
10/4/2024	15:30:00	6.98	6.46	3.29	6.64	5.64	3.09	-3.55	-3.55
10/4/2024	15:45:00	8.49	4.13	14.84	7.45	5.03	4.54	-2.91	-2.91
10/4/2024	16:00:00	1.70	1.57	14.92	6.63	4.62	7.29	0.66	0.66
10/4/2024	16:15:00	2.39	0.72	15.47	4.99	3.67	10.03	5.04	5.04
10/4/2024	16:30:00	2.43	0.98	3.60	4.40	2.77	10.42	6.03	6.03
10/4/2024	16:45:00	7.79	0.49	0.21	4.56	1.58	9.81	5.25	5.25
10/4/2024	17:00:00	9.15	1.08	1.34	4.69	0.97	7.11	2.42	2.42
10/4/2024	17:15:00	8.90	0.34	1.38	6.13	0.72	4.40	-1.73	-1.73
10/4/2024	17:30:00	8.15	0.00	0.61	7.28	0.58	1.43	-5.85	-5.85