

**GOWANUS CANAL SUPERFUND SITE  
RTA2 REMEDIAL CONSTRUCTION  
Water Quality Monitoring Weekly Data Summary**

**PERIOD: February 10, 2025 – February 14, 2025**

**Date of Report: February 18, 2025**

**Report Contents**

- Scope of Monitoring
- Report of Exceedances
- Turbidity Buoy Data
- Summary of Visual Observations

*Prepared by*

B&B Engineers & Geologists ▶  
of new york, p.c.

*an affiliate of Geosyntec Consultants*

1255 Roberts Blvd, Suite 200  
Kennesaw, GA 30144  
Project Number JR0289B

## **1. SCOPE OF MONITORING**

### **1.1 Buoy Locations**

In accordance with the Water Quality Monitoring Plan for In-waterway Construction Activities (WQMP) issued March 27, 2024, buoys equipped with multi-parameter water quality sondes, were deployed to monitor turbidity related to RTA2 construction activities. Buoys were deployed in the Fourth Street Turning Basin (TB4) to monitor background turbidity unaffected by in-water construction activities and at the North Carroll Street Bridge, which is referred to as the ambient buoy. A sentinel buoy was deployed north of 3<sup>rd</sup> Street Bridge (3SB), along the west bulkhead. These buoys (Figure 1) are in use to monitor the RTA2 pre-construction activities.


All readings from buoys were transmitted via telemetry at 15-minute intervals. The instrument used to collect turbidity from the buoys is an In-Situ VuLink (telemetry) and AquaTroll500 (sonde), equipped with optical sensors capable of reading turbidity levels with an accuracy of +/- 0.5 NTU.

### **1.2 Summary of Monitoring Adjustments during Construction**

- August 9, 2024, after the conclusion of RTA1 WQMP, two additional buoys were added to the RTA2 WQMP, for a total of three sentinel buoys. The ambient buoy was moved to approximately ten meters north of Carroll Street Bridge, on the west side of the canal (ambient). A sentinel buoy was placed approximately twenty meters north of 3<sup>rd</sup> Street Bridge on the west side (3SB). A sentinel buoy was placed in Fourth Street Turning Basin (TB4). The 9<sup>th</sup> Street Bridge sentinel buoy (9SB) was not moved.
- To reduce instrument downtime, the 9th Street Bridge sentinel buoy (9SB) was relocated to the northeast side of the 9th Street Bridge on August 19, 2024. After two days of data collection, elevated turbidity readings were observed both during and outside of work hours. Consequently, on August 21, 2024, the buoy was moved again, this time to the northeast corner of the Hamilton Street Bridge.
- Turbidity readings at the Hamilton Street Bridge location exceeded 100 NTU both during and outside working hours. However, these readings were not representative of the actual turbidity within the RTA2 work area. Due to commercial traffic, a safe location for the sonde and buoy could not be found south of the 9th Street Bridge. Consequently, the sonde and buoy were relocated to the west side, 5 meters north of the 9th Street Bridge on Tuesday, August 27, 2024, at 08:15.
- Turbidity readings at 9SB were noted to be erratic and exceed 100 NTU both during and outside working hours. The buoy was moved approximately 20 meters north of 9<sup>th</sup> Street Bridge on Monday, September 9, 2024.
- On September 16, 2024, the 9SB was deselected from construction monitoring, as there are no construction activities in the main canal or in the vicinity of 9<sup>th</sup> Street Bridge. The

buoy will remain in the water to collect background data as it is believed this area has naturally high NTU readings. A spot check zero calibration was performed on the buoy on Wednesday, September 18, 2024 to confirm the sensors were reading properly during this background monitoring period.

- On November 7, 2024, the ambient sonde and buoy was moved to the center of Carroll Street Bridge in an effort to reduce instrument downtime due to poor cell signal. This area was found to have a 100% cellular signal.
- On November 18, 2024, the sentinel buoy in TB4 was deselected from construction monitoring due to instrument errors. The buoy will remain out of service until maintenance and field observations can be made.
- On November 25, 2024, the 9SB sonde and buoy were placed back into the water quality monitoring program.
- On December 18, 2024, the 9SB sonde and buoy were relocated south of 9<sup>th</sup> Street Bridge along the eastern bulkhead, to avoid construction vessel traffic and shallow waters which had been resulting in false elevated readings, particularly during low tide events.
- On February 12, 2025, after observing a pause in data transmission, the ambient sonde and buoy were moved in an attempt to get a better signal in the area. It was moved to approximately 150 feet north of Carroll Street Bridge, to the center of the canal. On February 14, 2025, with data transmission issues not resolving, the ambient sonde and buoy were moved to approximately 200 feet south of Union Street Bridge, in the center of the canal where stronger signal strength has been observed. A test upload was performed; however data did not upload. Further troubleshooting will be required.

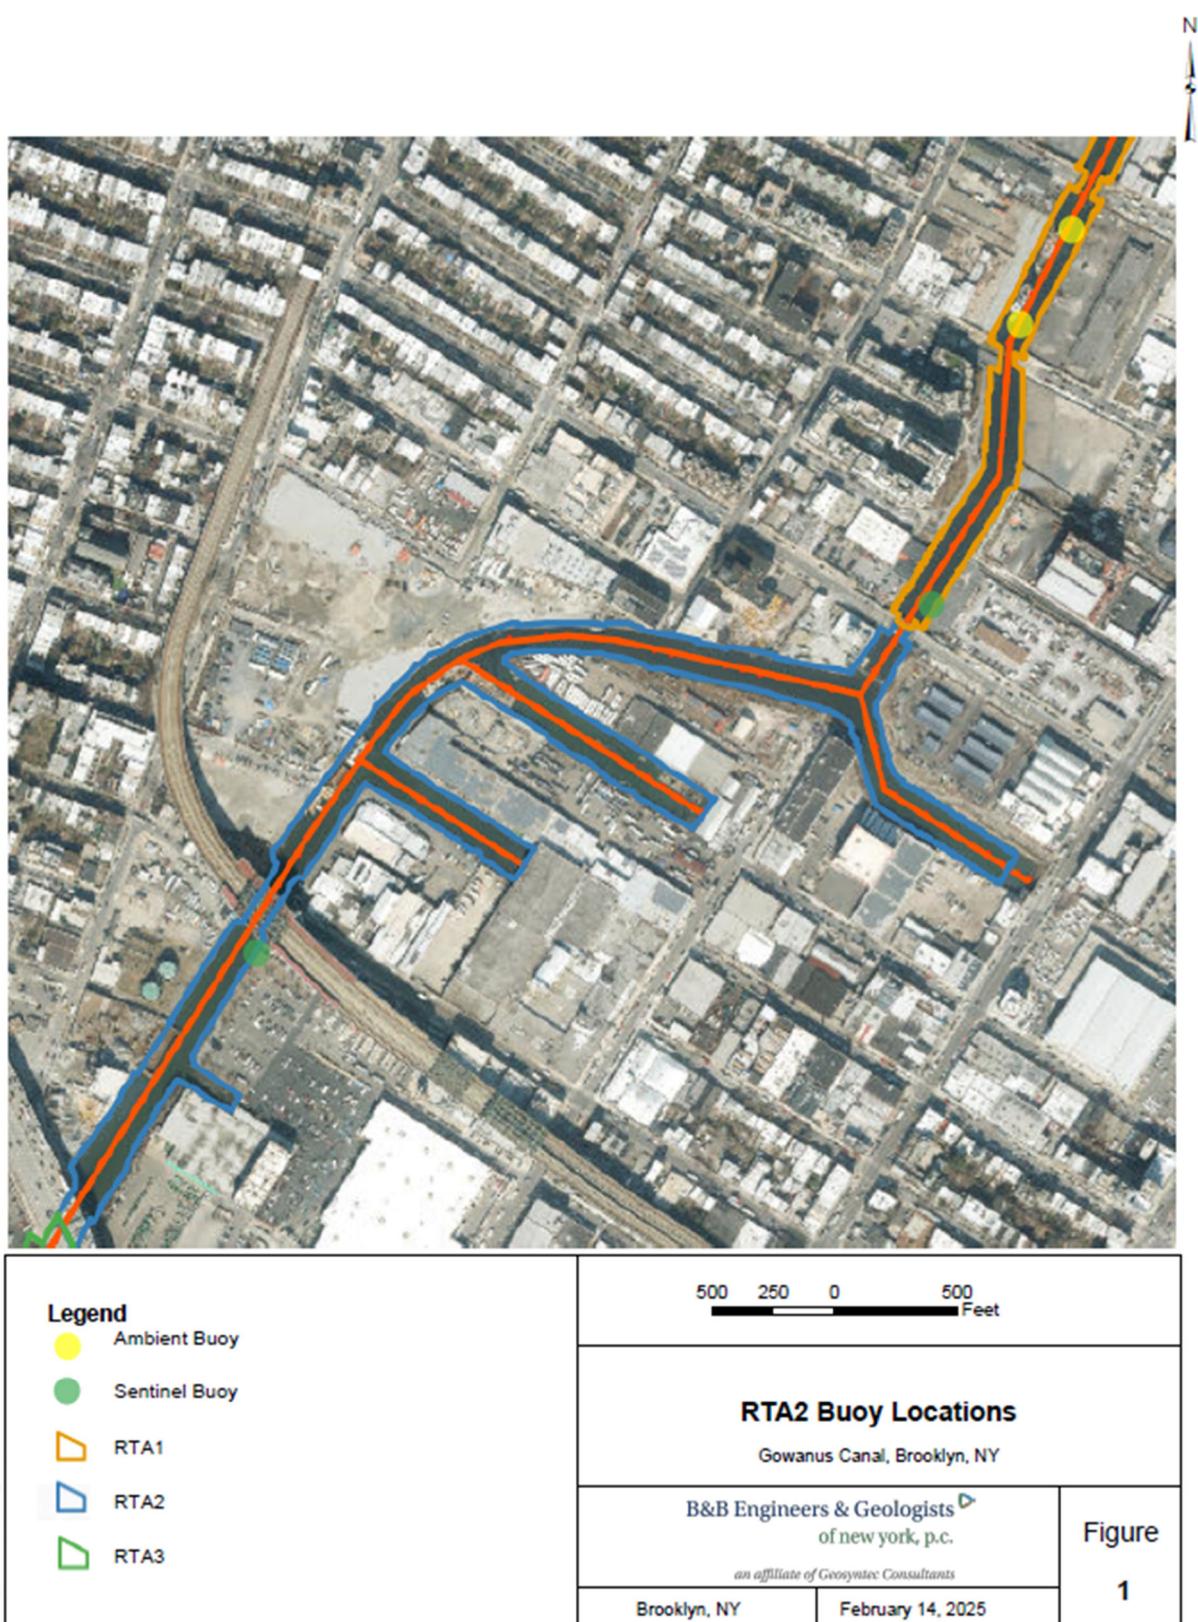

### **1.3 Current Reporting Period Scope of Monitoring**

During the week of February 10<sup>th</sup>, 2025, three buoys equipped with multi-parameter water quality sondes were deployed as described in Section 1.2.

All readings from buoys were transmitted via telemetry at 15-minute intervals. The instrument used to collect turbidity and DO from the buoys is an In-Situ VuLink (telemetry) and AquaTroll500 (sonde), equipped with optical sensors capable of reading turbidity levels with an accuracy of +/- 0.5 NTU and DO levels with an accuracy of +/- 0.1 mg/L.

Visual observations of turbidity and sheen are summarized in Section 4.

### **1.4 Meteorological Conditions**

The weather conditions onsite were as follows:

Meteorological Parameters	2/10/2025	2/11/2025	2/12/2025	2/13/2025	2/14/2025
<i>Wind Direction (from)</i>	NW	WSW	NE	NW	WNW
<i>Wind Speed (mph)</i>	5.1	3.3	6.2	7.3	8.2
<i>Temperature (°F)</i>	33.7	31.0	33.3	39.4	32.4
<i>Humidity (%)</i>	53.3	61.5	88.9	87.9	44.9
<i>Barometric Pressure (inHg)</i>	30.25	30.26	30.14	29.83	30.36
<i>Precipitation (Inch)</i>	0.059	0	0.15	0.441	0


Table 1 - Summary of Weather Conditions for reporting period.

### **1.5 Tidal Conditions**

Tidal data from the Battery (National Oceanic and Atmospheric Administration [NOAA] Station 8518750) was reviewed and is summarized as follows:

Date	Time (LST/LDT)	Predicted (ft)	Preliminary (ft)	High/Low
Monday, February 10, 2025	12:11 AM	-2.89	-2.16	L
Monday, February 10, 2025	6:29 AM	2.03	2.82	H
Monday, February 10, 2025	1:00 PM	-3.21	-2.42	L
Monday, February 10, 2025	6:58 PM	1.43	1.61	H
Tuesday, February 11, 2025	1:02 AM	-3	-2.78	L
Tuesday, February 11, 2025	7:15 AM	2.14	2.51	H
Tuesday, February 11, 2025	1:47 PM	-3.35	-3.02	L
Tuesday, February 11, 2025	7:42 PM	1.59	2.01	H
Wednesday, February 12, 2025	1:50 AM	-3.08	-2.22	L
Wednesday, February 12, 2025	7:57 AM	2.16	3.15	H
Wednesday, February 12, 2025	2:29 PM	-3.41	-2.13	L
Wednesday, February 12, 2025	8:24 PM	1.69	3.06	H
Thursday, February 13, 2025	2:34 AM	-3.1	-1.15	L
Thursday, February 13, 2025	8:37 AM	2.08	3.96	H
Thursday, February 13, 2025	3:08 PM	-3.38	-1.65	L
Thursday, February 13, 2025	9:05 PM	1.71	1.9	H
Friday, February 14, 2025	3:15 AM	-3.06	-3.25	L
Friday, February 14, 2025	9:16 AM	1.91	1.08	H
Friday, February 14, 2025	3:44 PM	-3.26	-4.02	L

**Table 2 - NOAA Preliminary observations and predictions.**

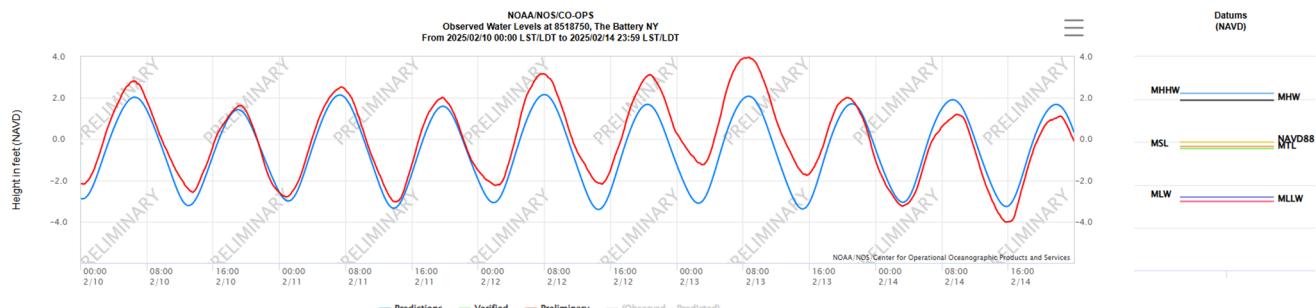

**Figure 2 - Tidal Chart for reporting period.**

## 2. REPORT OF EXCEEDANCES

No exceedances of the quantitative trigger or action criterion occurred during this reporting period. Turbidity and floatables were observed throughout the reporting period unrelated to construction activities.

- **Trigger criterion – Any of the following:**
  - The rolling average of the relevant sentinel buoy turbidity measurements over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 20 NTU excluding any eliminated outlier measurements and in-waterway

- construction activities cannot be immediately excluded as the source following consultation with EPA; or
- Either an oil sheen or a turbidity plume is visually observed at the relevant sentinel buoy and in-waterway construction activities are readily identified as the source.
  - **Action criterion** – Any of the following:
    - The rolling average of the turbidity measurements of the sentinel buoy outside of RTA2 over a one-hour period exceeds the rolling average of the ambient buoy turbidity measurements by 40 NTU excluding any eliminated outlier measurements and in-waterway construction activities cannot be immediately excluded as the source following consultation with EPA; or
    - Either an oil sheen or a turbidity plume is visually observed outside of RTA2, and any deployed engineering controls and in-waterway construction activities are readily identified as the source.

An outlier is defined as a reading that is outside the range of 50 to 200 percent of the average of the three previous readings. In addition, to be considered an outlier, the subsequent reading must return to a range of 75 to 133 percent of the average of the three readings preceding the outlier.


## **2.1 Response to Criteria Exceedances**

The trigger level criterion serves to provide early notification to the contractor of construction activities that may lead to an exceedance of the action level criterion. In the event of an exceedance to the trigger criterion, the contractor will not be stopped, and the contractor will be directed to investigate the source of the exceedance and evaluate Best Management Practices (BMPs). In the event of an exceedance to the action level criterion, in-waterway construction activities may be slowed or temporarily suspended as necessary while the contractor investigates the source of the exceedance and appropriate mitigation, and corrective measures are determined. A more detailed description of responses to exceedances of the trigger and action level criteria is provided in Section 4.2 of the WQMP.

## **3. TURBIDITY BUOY DATA**


Throughout the reporting period, readings at the Ambient, 3SB, and 9SB sondes remained relatively stable. No exceedances or elevated reading were reported by any of the buoys. The Ambient buoy began experiencing telemetry issues on Wednesday, February 12<sup>th</sup>, 2025. As a result, the trigger and action criterion limits for Wednesday February 12<sup>th</sup>, Thursday February 13<sup>th</sup>, and Friday February 14<sup>th</sup>, 2025 were set to 20 and 40 NTU, respectively, to allow for conservative monitoring of the sentinel buoy stations.

### 3.1 Monday, February 10, 2025

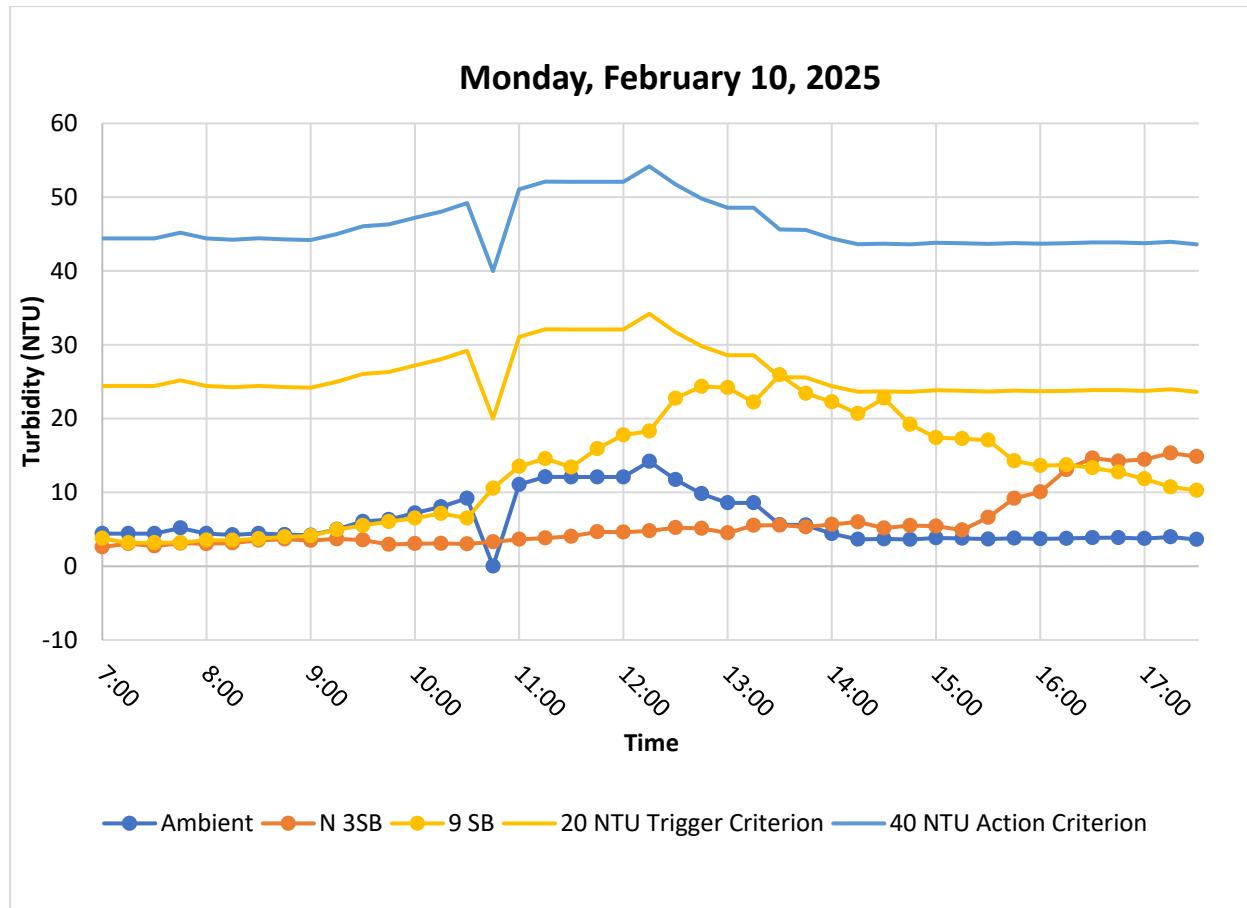


**Figure 3.** Hourly rolling average turbidity readings from 07:00 to 17:30.

### 3.2 Tuesday, February 11, 2025

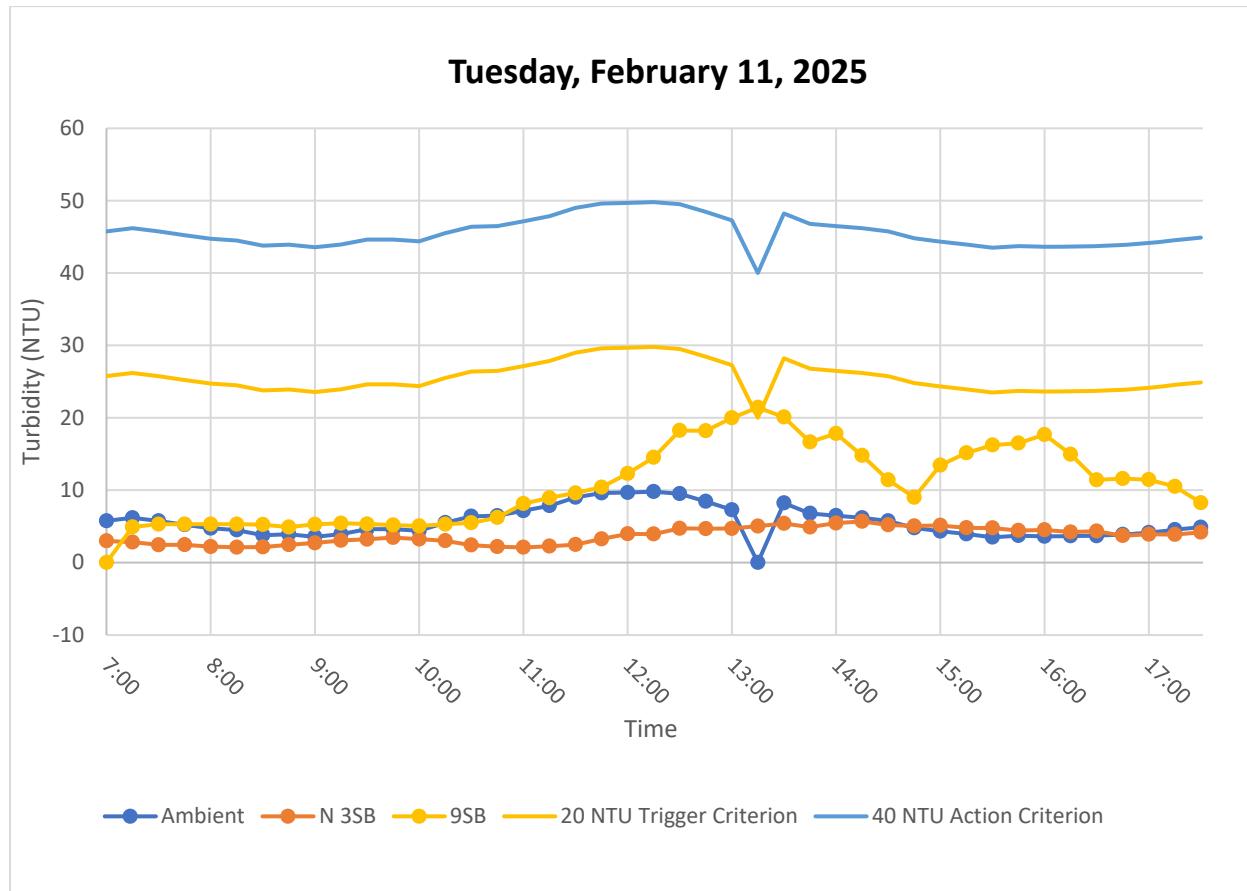


**Figure 4.** Hourly rolling average turbidity readings from 07:00 to 17:30.

### 3.3 Wednesday, February 12, 2025

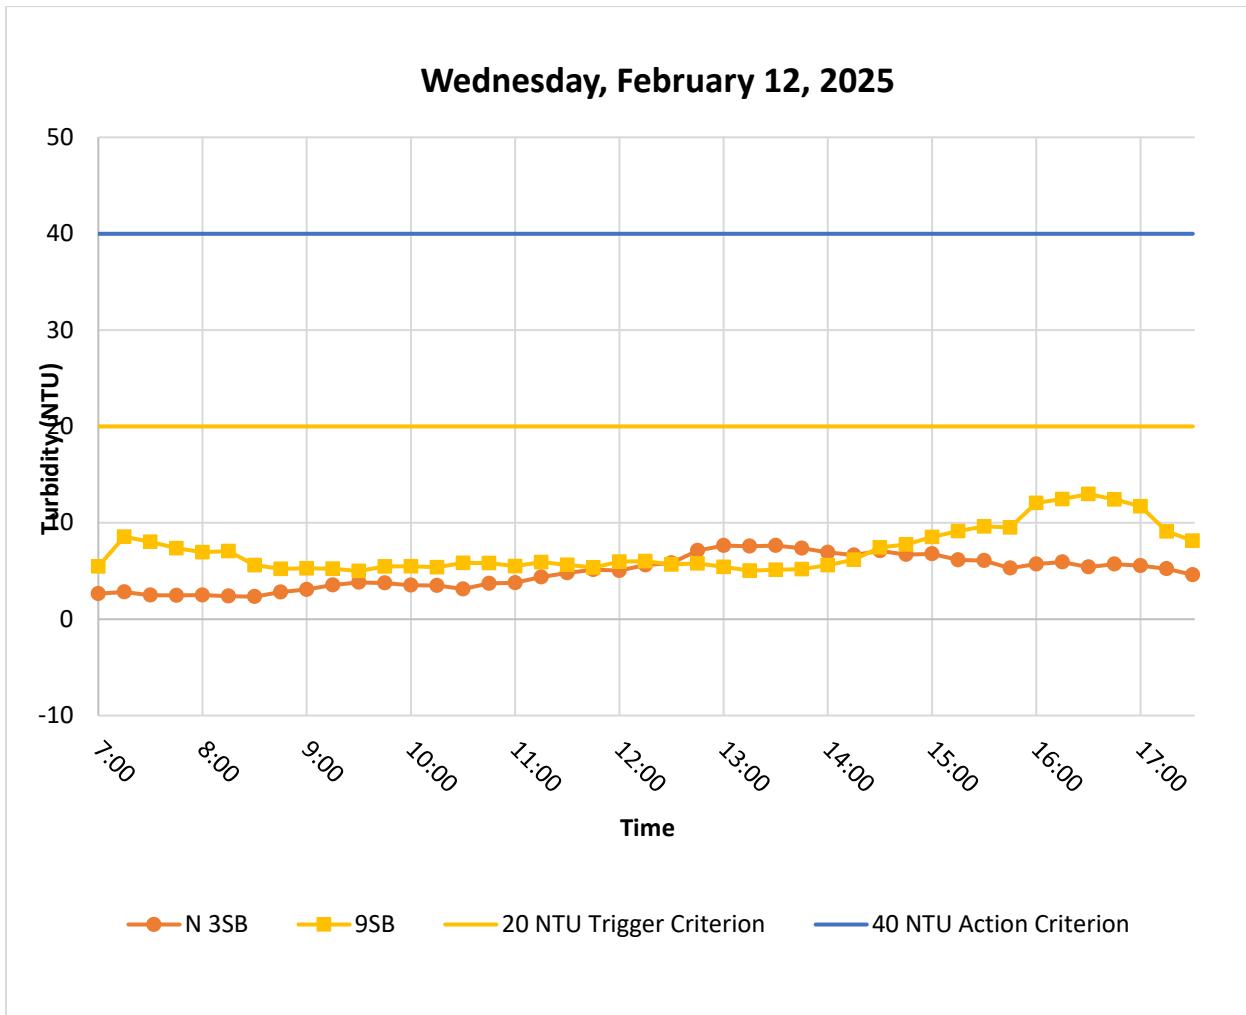


**Figure 5 .** Hourly rolling average turbidity readings from 07:00 to 17:30.

### 3.4 Thursday, February 13, 2025

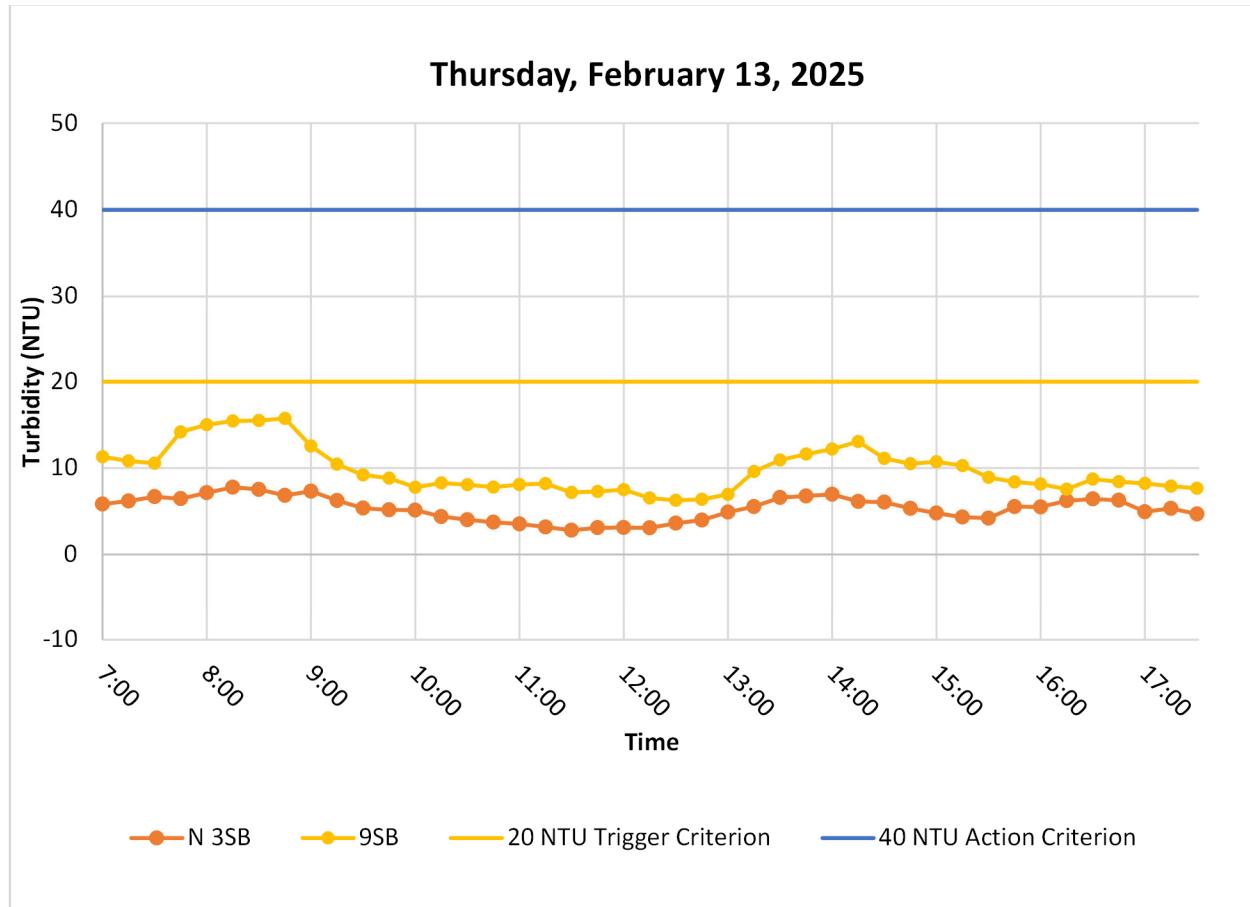

**Figure 6.** Hourly rolling average turbidity readings from 07:00 to 17:30.

### 3.5 Friday, February 14, 2025

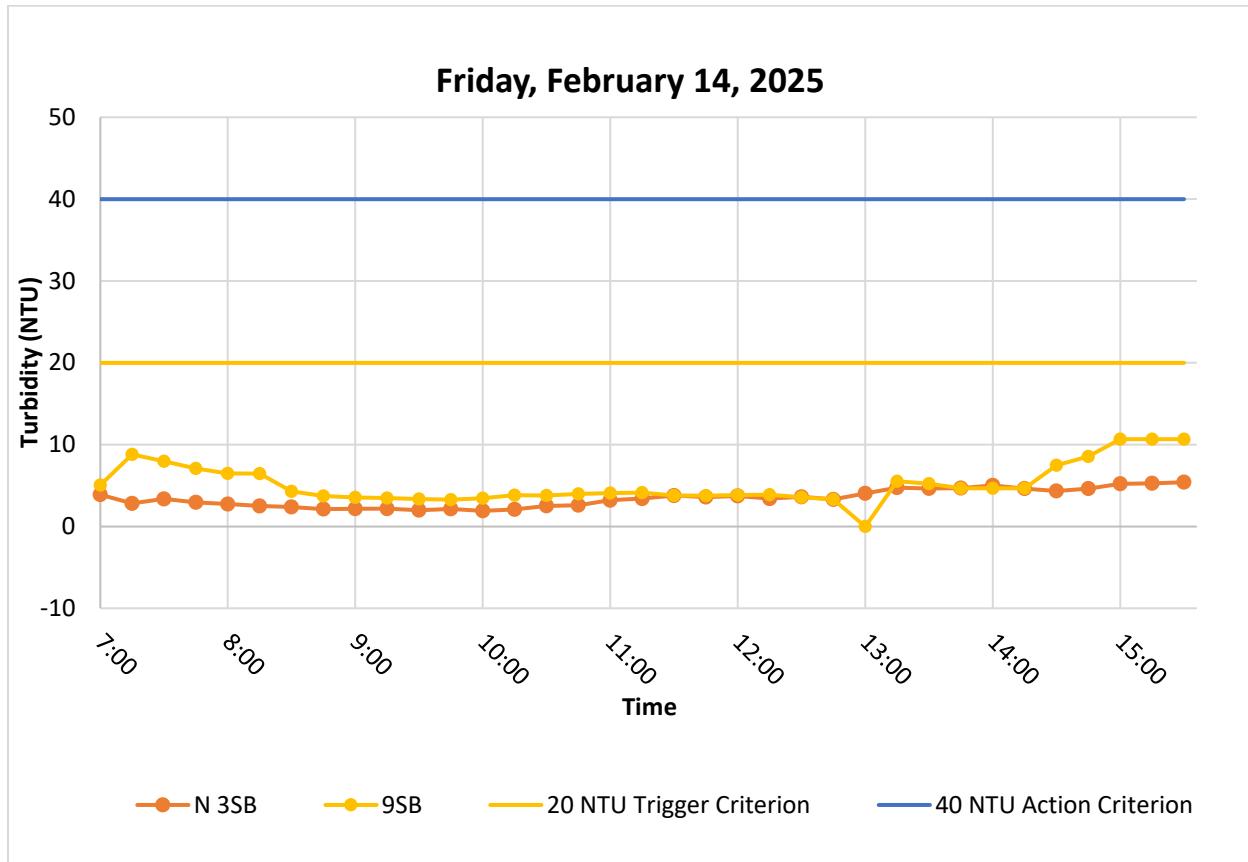


**Figure 7.** Hourly rolling average turbidity readings from 07:00 to 15:30.

#### 4. SUMMARY OF VISUAL OBSERVATIONS


Throughout the majority of the reporting period, sheens in the RTA2 areas ranged from minimal to moderate.



**Figure 8 – February 11, 2025.** General Conditions in Canal north of 9<sup>th</sup> Street Bridge near TB6 during in-waterway construction activities.

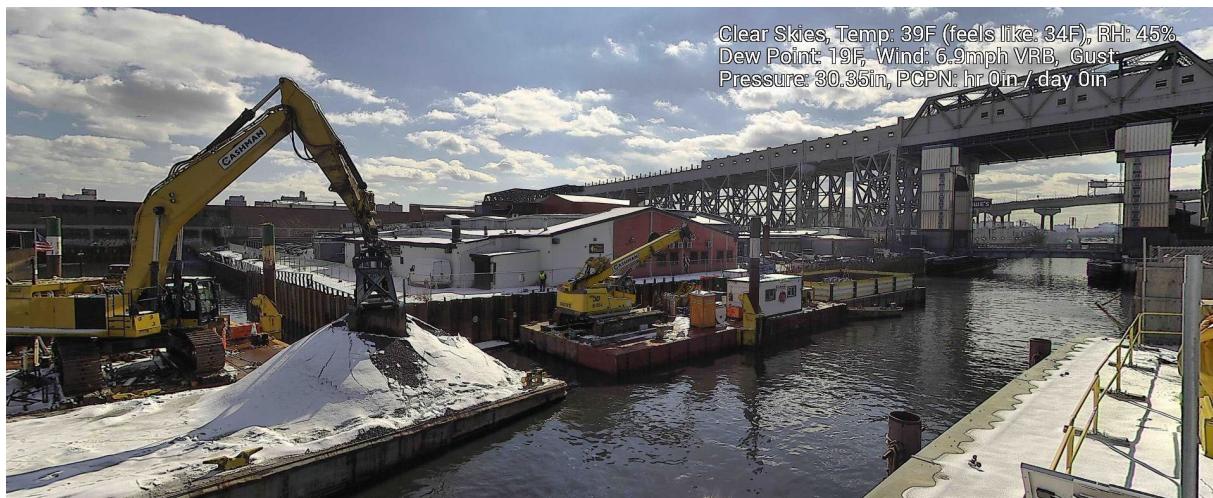

**Figure 9 – February 10, 2025.** General Conditions in Canal north of 9<sup>th</sup> Street Bridge near TB7 during in-waterway construction activities.

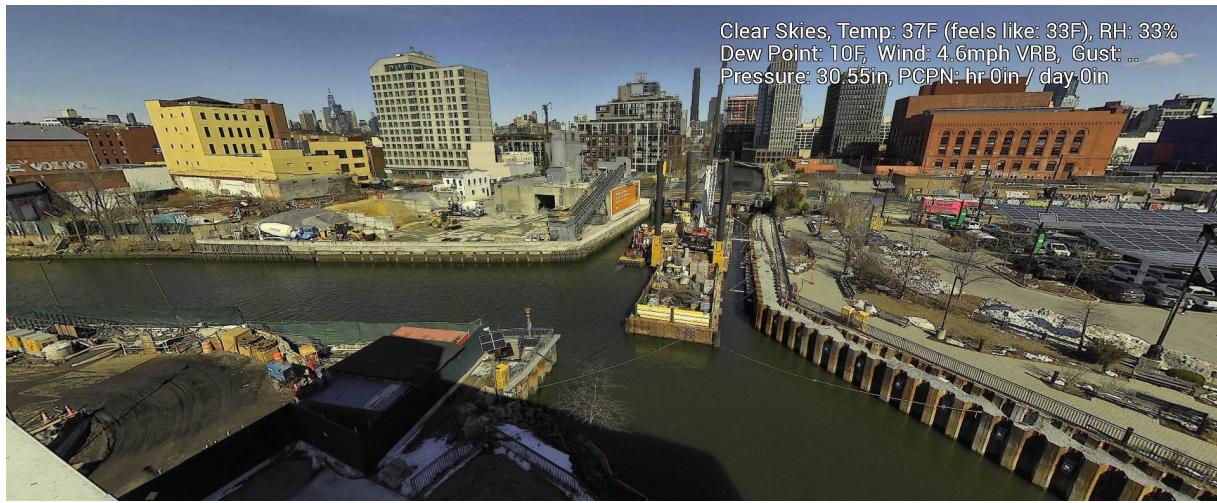

Clear Skies, Temp: 37F (feels like: 33F), RH: 33%  
Dew Point: 10F, Wind: 4.6mph VRB, Gust: ..  
Pressure: 30.55in, PCPN: hr 0in / day 0in

**Figure 10 – February 14, 2025.** General Conditions in Canal south of 3<sup>rd</sup> Street Bridge near TB4 during in-waterway construction activities.

## **APPENDIX A**

### **Turbidity Data Tables**

Table 3

Monday, Feb 10, 2025

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	9SB	Ambient	N3SB	9SB	N3SB - Ambient	9SB - Ambient
2/10/2025	7:00:00	4.41	2.59	3.76	4.41	2.59	3.76	-1.82	-0.65
2/10/2025	7:15:00	--	3.52	2.54	4.41	3.05	3.15	-1.36	-1.26
2/10/2025	7:30:00	--	2.05	3.23	4.41	2.72	3.18	-1.69	-1.23
2/10/2025	7:45:00	5.94	4.26	3.20	5.18	3.10	3.18	-2.07	-1.99
2/10/2025	8:00:00	2.89	2.79	4.87	4.41	3.04	3.52	-1.37	-0.89
2/10/2025	8:15:00	3.88	3.08	3.67	4.24	3.14	3.50	-1.10	-0.73
2/10/2025	8:30:00	4.98	5.33	3.57	4.42	3.50	3.71	-0.92	-0.71
2/10/2025	8:45:00	3.67	2.82	4.46	4.27	3.65	3.96	-0.62	-0.32
2/10/2025	9:00:00	5.52	3.39	4.00	4.19	3.48	4.12	-0.71	-0.07
2/10/2025	9:15:00	6.88	3.81	9.02	4.99	3.69	4.94	-1.30	-0.04
2/10/2025	9:30:00	9.19	2.40	6.49	6.05	3.55	5.51	-2.50	-0.54
2/10/2025	9:45:00	--	2.31	6.16	6.31	2.94	6.03	-3.37	-0.29
2/10/2025	10:00:00	--	3.31	6.86	7.20	3.04	6.51	-4.15	-0.69
2/10/2025	10:15:00	--	3.57	--	8.04	3.08	7.13	-4.96	-0.90
2/10/2025	10:30:00	--	3.42	--	9.19	3.00	6.50	-6.19	-2.69
2/10/2025	10:45:00	--	3.88	18.65	--	3.30	10.56	--	--
2/10/2025	11:00:00	11.06	4.00	15.05	11.06	3.64	13.52	-7.42	2.46
2/10/2025	11:15:00	13.13	4.15	10.02	12.09	3.80	14.57	-8.29	2.48
2/10/2025	11:30:00	12.03	4.70	9.96	12.07	4.03	13.42	-8.04	1.35
2/10/2025	11:45:00	--	6.55	25.88	12.07	4.66	15.91	-7.42	3.84
2/10/2025	12:00:00	--	3.63	27.98	12.07	4.61	17.78	-7.47	5.71
2/10/2025	12:15:00	17.45	4.86	17.62	14.20	4.78	18.29	-9.42	4.09
2/10/2025	12:30:00	5.72	6.32	32.27	11.73	5.21	22.74	-6.52	11.01
2/10/2025	12:45:00	6.26	4.21	17.96	9.81	5.12	24.35	-4.69	14.54
2/10/2025	13:00:00	4.87	3.49	25.09	8.57	4.50	24.19	-4.07	15.61
2/10/2025	13:15:00	--	8.70	18.11	8.57	5.52	22.21	-3.06	13.64
2/10/2025	13:30:00	--	5.05	36.22	5.62	5.55	25.93	-0.06	20.32
2/10/2025	13:45:00	--	5.14	19.71	5.56	5.32	23.42	-0.25	17.86
2/10/2025	14:00:00	3.94	5.89	12.17	4.40	5.65	22.26	1.25	17.86
2/10/2025	14:15:00	3.32	5.17	17.15	3.63	5.99	20.67	2.36	17.04
2/10/2025	14:30:00	3.79	4.57	28.49	3.68	5.16	22.75	1.48	19.06
2/10/2025	14:45:00	3.37	6.71	18.54	3.61	5.50	19.21	1.89	15.61
2/10/2025	15:00:00	4.69	4.74	10.72	3.82	5.42	17.41	1.59	13.59
2/10/2025	15:15:00	3.62	3.24	11.45	3.76	4.89	17.27	1.13	13.51
2/10/2025	15:30:00	2.87	13.74	16.20	3.67	6.60	17.08	2.93	13.41
2/10/2025	15:45:00	4.38	17.55	14.40	3.79	9.20	14.26	5.41	10.47
2/10/2025	16:00:00	2.91	11.01	15.37	3.69	10.05	13.63	6.36	9.93
2/10/2025	16:15:00	4.98	19.86	11.16	3.75	13.08	13.72	9.32	9.96
2/10/2025	16:30:00	4.13	11.00	9.49	3.85	14.63	13.32	10.78	9.47
2/10/2025	16:45:00	2.90	11.72	13.25	3.86	14.23	12.73	10.37	8.87
2/10/2025	17:00:00	3.81	18.73	9.90	3.75	14.46	11.83	10.72	8.09
2/10/2025	17:15:00	--	15.28	9.87	3.95	15.32	10.73	11.36	6.78
2/10/2025	17:30:00	--	17.53	8.83	3.61	14.85	10.27	11.24	6.66

Table 4

Tuesday, Feb 11, 2025

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	9SB	Ambient	N3SB	9SB	N3SB - Ambient	9SB - Ambient
2/11/25	7:00:00	5.75	2.98	--	5.75	2.98	--	-2.77	--
2/11/25	7:15:00	6.60	2.66	4.91	6.18	2.82	4.91	-3.36	-1.26
2/11/25	7:30:00	4.89	1.68	5.68	5.75	2.44	5.30	-3.31	-0.45
2/11/25	7:45:00	3.62	2.49	--	5.22	2.45	5.30	-2.77	0.08
2/11/25	8:00:00	2.81	1.21	--	4.74	2.20	5.30	-2.53	0.56
2/11/25	8:15:00	--	2.54	--	4.48	2.11	5.30	-2.37	0.82
2/11/25	8:30:00	--	2.78	4.80	3.77	2.14	5.24	-1.64	1.47
2/11/25	8:45:00	5.29	3.24	4.99	3.91	2.45	4.90	-1.45	0.99
2/11/25	9:00:00	2.56	3.74	6.01	3.55	2.70	5.27	-0.85	1.72
2/11/25	9:15:00	3.94	2.95	5.90	3.93	3.05	5.43	-0.88	1.50
2/11/25	9:30:00	6.64	3.38	4.85	4.61	3.22	5.31	-1.39	0.70
2/11/25	9:45:00	--	3.93	4.10	4.61	3.45	5.17	-1.16	0.56
2/11/25	10:00:00	--	2.20	4.38	4.38	3.24	5.05	-1.14	0.67
2/11/25	10:15:00	5.91	2.55	7.24	5.50	3.00	5.30	-2.50	-0.20
2/11/25	10:30:00	6.59	0.00	6.82	6.38	2.41	5.48	-3.97	-0.90
2/11/25	10:45:00	6.90	2.23	8.47	6.47	2.18	6.20	-4.29	-0.26
2/11/25	11:00:00	9.18	3.55	13.75	7.15	2.11	8.13	-5.04	0.99
2/11/25	11:15:00	10.67	2.91	8.41	7.85	2.25	8.94	-5.60	1.09
2/11/25	11:30:00	11.62	3.66	10.56	8.99	2.47	9.60	-6.52	0.61
2/11/25	11:45:00	9.61	3.97	10.82	9.60	3.26	10.40	-6.33	0.80
2/11/25	12:00:00	7.28	5.68	17.89	9.67	3.95	12.28	-5.72	2.61
2/11/25	12:15:00	--	3.45	24.94	9.80	3.93	14.52	-5.86	4.72
2/11/25	12:30:00	--	6.81	26.97	9.51	4.72	18.23	-4.79	8.73
2/11/25	12:45:00	--	3.46	10.41	8.45	4.67	18.20	-3.77	9.76
2/11/25	13:00:00	--	4.09	19.71	7.28	4.70	19.98	-2.58	12.71
2/11/25	13:15:00	--	7.30	25.08	--	5.02	21.42	--	--
2/11/25	13:30:00	8.22	5.32	18.28	8.22	5.40	20.09	-2.83	11.87
2/11/25	13:45:00	5.34	4.29	9.79	6.78	4.89	16.65	-1.89	9.87
2/11/25	14:00:00	5.86	6.26	16.22	6.47	5.45	17.82	-1.02	11.34
2/11/25	14:15:00	5.30	5.30	4.56	6.18	5.69	14.79	-0.49	8.60
2/11/25	14:30:00	3.99	4.81	8.18	5.74	5.20	11.41	-0.55	5.66
2/11/25	14:45:00	3.45	4.60	6.27	4.79	5.05	9.00	0.26	4.21
2/11/25	15:00:00	3.02	4.69	31.93	4.32	5.13	13.43	0.81	9.11
2/11/25	15:15:00	--	4.57	24.75	3.94	4.79	15.14	0.85	11.20
2/11/25	15:30:00	--	5.18	9.98	3.49	4.77	16.22	1.28	12.74
2/11/25	15:45:00	4.65	3.09	9.48	3.71	4.42	16.48	0.72	12.78
2/11/25	16:00:00	3.18	5.00	12.20	3.62	4.50	17.67	0.89	14.05
2/11/25	16:15:00	3.20	3.23	18.32	3.68	4.21	14.95	0.54	11.27
2/11/25	16:30:00	3.71	5.18	7.12	3.68	4.33	11.42	0.65	7.74
2/11/25	16:45:00	4.61	2.08	10.85	3.87	3.71	11.59	-0.16	7.72
2/11/25	17:00:00	6.03	3.99	8.75	4.15	3.89	11.45	-0.25	7.30
2/11/25	17:15:00	5.15	4.84	7.50	4.54	3.86	10.51	-0.68	5.97
2/11/25	17:30:00	--	4.79	7.07	4.87	4.17	8.26	-0.70	3.38

Table 5

Wednesday, Feb 12, 2025

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	9SB	Ambient	N3SB	9SB	N3SB - Ambient	9SB - Ambient
2/12/2025	7:00:00	--	2.64	5.47	--	2.64	5.47	--	--
2/12/2025	7:15:00	--	2.98	11.63	--	2.81	8.55	--	--
2/12/2025	7:30:00	--	1.81	6.99	--	2.48	8.03	--	--
2/12/2025	7:45:00	--	2.39	5.38	--	2.46	7.37	--	--
2/12/2025	8:00:00	--	2.65	5.26	--	2.50	6.95	--	--
2/12/2025	8:15:00	--	2.09	6.01	--	2.39	7.05	--	--
2/12/2025	8:30:00	--	2.78	4.33	--	2.35	5.59	--	--
2/12/2025	8:45:00	--	4.12	5.13	--	2.81	5.22	--	--
2/12/2025	9:00:00	--	3.71	5.61	--	3.07	5.27	--	--
2/12/2025	9:15:00	--	4.97	5.07	--	3.53	5.23	--	--
2/12/2025	9:30:00	--	3.49	4.85	--	3.81	5.00	--	--
2/12/2025	9:45:00	--	2.45	6.71	--	3.75	5.48	--	--
2/12/2025	10:00:00	--	2.93	5.20	--	3.51	5.49	--	--
2/12/2025	10:15:00	--	3.60	5.05	--	3.49	5.38	--	--
2/12/2025	10:30:00	--	3.14	7.38	--	3.12	5.84	--	--
2/12/2025	10:45:00	--	6.41	4.77	--	3.70	5.82	--	--
2/12/2025	11:00:00	--	2.77	5.12	--	3.77	5.51	--	--
2/12/2025	11:15:00	--	5.93	7.28	--	4.37	5.92	--	--
2/12/2025	11:30:00	--	5.71	3.59	--	4.79	5.63	--	--
2/12/2025	11:45:00	--	4.85	5.97	--	5.13	5.35	--	--
2/12/2025	12:00:00	--	5.93	7.83	--	5.04	5.96	--	--
2/12/2025	12:15:00	--	5.66	5.44	--	5.62	6.02	--	--
2/12/2025	12:30:00	--	6.97	5.52	--	5.82	5.67	--	--
2/12/2025	12:45:00	--	12.16	4.15	--	7.11	5.78	--	--
2/12/2025	13:00:00	--	7.50	4.13	--	7.64	5.41	--	--
2/12/2025	13:15:00	--	5.53	5.97	--	7.56	5.04	--	--
2/12/2025	13:30:00	--	6.01	5.85	--	7.63	5.13	--	--
2/12/2025	13:45:00	--	5.56	5.83	--	7.35	5.19	--	--
2/12/2025	14:00:00	--	10.01	6.24	--	6.92	5.60	--	--
2/12/2025	14:15:00	--	6.11	6.98	--	6.65	6.17	--	--
2/12/2025	14:30:00	--	7.71	12.32	--	7.08	7.44	--	--
2/12/2025	14:45:00	--	4.10	7.39	--	6.70	7.75	--	--
2/12/2025	15:00:00	--	5.89	9.68	--	6.77	8.52	--	--
2/12/2025	15:15:00	--	6.90	9.32	--	6.14	9.14	--	--
2/12/2025	15:30:00	--	5.75	9.40	--	6.07	9.62	--	--
2/12/2025	15:45:00	--	3.78	11.78	--	5.29	9.52	--	--
2/12/2025	16:00:00	--	6.25	20.11	--	5.72	12.06	--	--
2/12/2025	16:15:00	--	6.93	11.67	--	5.92	12.46	--	--
2/12/2025	16:30:00	--	4.31	11.97	--	5.40	12.99	--	--
2/12/2025	16:45:00	--	7.25	6.61	--	5.71	12.43	--	--
2/12/2025	17:00:00	--	2.98	8.19	--	5.54	11.71	--	--
2/12/2025	17:15:00	--	4.65	7.10	--	5.22	9.11	--	--
2/12/2025	17:30:00	--	3.80	6.85	--	4.60	8.14	--	--

Table 6

Thursday, Feb 13, 2025

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	9SB	Ambient	N3SB	9SB	N3SB - Ambient	9SB - Ambient
2/13/2025	7:00:00	--	5.83	11.32	--	5.83	11.32	--	--
2/13/2025	7:15:00	--	6.54	10.34	--	6.19	10.83	--	--
2/13/2025	7:30:00	--	7.66	10.05	--	6.68	10.57	--	--
2/13/2025	7:45:00	--	5.82	25.04	--	6.46	14.19	--	--
2/13/2025	8:00:00	--	9.87	18.40	--	7.15	15.03	--	--
2/13/2025	8:15:00	--	8.99	13.47	--	7.78	15.46	--	--
2/13/2025	8:30:00	--	5.32	10.58	--	7.53	15.51	--	--
2/13/2025	8:45:00	--	4.15	11.27	--	6.83	15.75	--	--
2/13/2025	9:00:00	--	8.28	8.99	--	7.32	12.54	--	--
2/13/2025	9:15:00	--	4.49	7.98	--	6.25	10.46	--	--
2/13/2025	9:30:00	--	4.61	7.22	--	5.37	9.21	--	--
2/13/2025	9:45:00	--	4.25	8.68	--	5.15	8.83	--	--
2/13/2025	10:00:00	--	4.02	5.97	--	5.13	7.77	--	--
2/13/2025	10:15:00	--	4.54	11.53	--	4.38	8.28	--	--
2/13/2025	10:30:00	--	2.65	6.92	--	4.01	8.07	--	--
2/13/2025	10:45:00	--	3.17	5.89	--	3.73	7.80	--	--
2/13/2025	11:00:00	--	3.28	10.11	--	3.53	8.08	--	--
2/13/2025	11:15:00	--	2.25	6.59	--	3.18	8.21	--	--
2/13/2025	11:30:00	--	2.65	6.41	--	2.80	7.18	--	--
2/13/2025	11:45:00	--	4.12	7.46	--	3.09	7.29	--	--
2/13/2025	12:00:00	--	3.27	6.94	--	3.11	7.50	--	--
2/13/2025	12:15:00	--	3.12	5.27	--	3.08	6.53	--	--
2/13/2025	12:30:00	--	4.93	5.24	--	3.62	6.26	--	--
2/13/2025	12:45:00	--	4.47	7.02	--	3.98	6.39	--	--
2/13/2025	13:00:00	--	8.72	10.27	--	4.90	6.95	--	--
2/13/2025	13:15:00	--	6.46	20.18	--	5.54	9.60	--	--
2/13/2025	13:30:00	--	8.38	11.96	--	6.59	10.94	--	--
2/13/2025	13:45:00	--	5.82	8.72	--	6.77	11.63	--	--
2/13/2025	14:00:00	--	5.44	9.87	--	6.96	12.20	--	--
2/13/2025	14:15:00	--	4.56	14.66	--	6.13	13.08	--	--
2/13/2025	14:30:00	--	--	10.39	--	6.05	11.12	--	--
2/13/2025	14:45:00	--	5.51	8.89	--	5.33	10.51	--	--
2/13/2025	15:00:00	--	3.63	9.86	--	4.79	10.73	--	--
2/13/2025	15:15:00	--	3.60	7.64	--	4.32	10.29	--	--
2/13/2025	15:30:00	--	4.08	7.82	--	4.20	8.92	--	--
2/13/2025	15:45:00	--	10.83	7.74	--	5.53	8.39	--	--
2/13/2025	16:00:00	--	5.38	7.65	--	5.50	8.14	--	--
2/13/2025	16:15:00	--	7.21	6.93	--	6.22	7.56	--	--
2/13/2025	16:30:00	--	4.63	13.44	--	6.43	8.72	--	--
2/13/2025	16:45:00	--	3.31	6.41	--	6.27	8.44	--	--
2/13/2025	17:00:00	--	4.22	6.63	--	4.95	8.21	--	--
2/13/2025	17:15:00	--	7.27	6.14	--	5.33	7.91	--	--
2/13/2025	17:30:00	--	4.00	5.70	--	4.68	7.67	--	--

Table 7

Friday, Feb 14, 2025

Date	Time	Turbidity (NTU)			Rolling Average Turbidity (NTU)			Difference (NTU)	
		Ambient	N3SB	9SB	Ambient	N3SB	9SB	N3SB - Ambient	9SB - Ambient
2/14/2025	7:00:00	--	3.88	3.23	--	3.88	5.04	--	--
2/14/2025	7:15:00	--	1.74	14.38	--	2.81	8.81	--	--
2/14/2025	7:30:00	--	4.45	6.25	--	3.36	7.96	--	--
2/14/2025	7:45:00	--	1.68	4.47	--	2.94	7.08	--	--
2/14/2025	8:00:00	--	1.91	4.06	--	2.73	6.48	--	--
2/14/2025	8:15:00	--	2.71	3.11	--	2.50	6.45	--	--
2/14/2025	8:30:00	--	1.12	3.58	--	2.38	4.29	--	--
2/14/2025	8:45:00	--	3.15	3.38	--	2.11	3.72	--	--
2/14/2025	9:00:00	--	1.88	3.63	--	2.15	3.55	--	--
2/14/2025	9:15:00	--	2.00	3.61	--	2.17	3.46	--	--
2/14/2025	9:30:00	--	1.75	2.58	--	1.98	3.35	--	--
2/14/2025	9:45:00	--	1.91	3.18	--	2.14	3.28	--	--
2/14/2025	10:00:00	--	2.05	4.23	--	1.92	3.45	--	--
2/14/2025	10:15:00	--	2.68	5.52	--	2.08	3.82	--	--
2/14/2025	10:30:00	--	4.16	3.40	--	2.51	3.78	--	--
2/14/2025	10:45:00	--	2.14	3.51	--	2.59	3.97	--	--
2/14/2025	11:00:00	--	5.00	3.67	--	3.20	4.07	--	--
2/14/2025	11:15:00	--	3.01	4.53	--	3.40	4.13	--	--
2/14/2025	11:30:00	--	4.53	3.80	--	3.77	3.78	--	--
2/14/2025	11:45:00	--	3.27	3.31	--	3.59	3.76	--	--
2/14/2025	12:00:00	--	2.82	--	--	3.73	3.83	--	--
2/14/2025	12:15:00	--	3.35	--	--	3.40	3.88	--	--
2/14/2025	12:30:00	--	4.09	--	--	3.61	3.56	--	--
2/14/2025	12:45:00	--	2.96	--	--	3.30	3.31	--	--
2/14/2025	13:00:00	--	6.95	--	--	4.03	--	--	--
2/14/2025	13:15:00	--	6.36	5.52	--	4.74	5.52	--	--
2/14/2025	13:30:00	--	2.86	4.91	--	4.65	5.21	--	--
2/14/2025	13:45:00	--	4.25	3.53	--	4.68	4.65	--	--
2/14/2025	14:00:00	--	4.63	--	--	5.01	4.65	--	--
2/14/2025	14:15:00	--	5.01	--	--	4.62	4.65	--	--
2/14/2025	14:30:00	--	4.90	13.99	--	4.33	7.48	--	--
2/14/2025	14:45:00	--	4.32	8.09	--	4.62	8.54	--	--
2/14/2025	15:00:00	--	7.17	9.90	--	5.21	10.66	--	--
2/14/2025	15:15:00	--	4.94	--	--	5.27	10.66	--	--
2/14/2025	15:30:00	--	5.70	--	--	5.41	10.66	--	--